
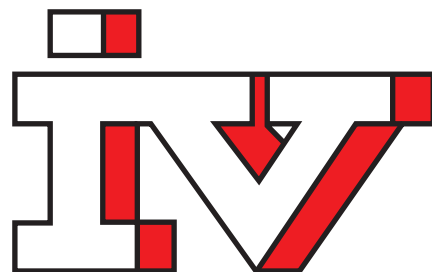


50201 E

# FLEXOPAC

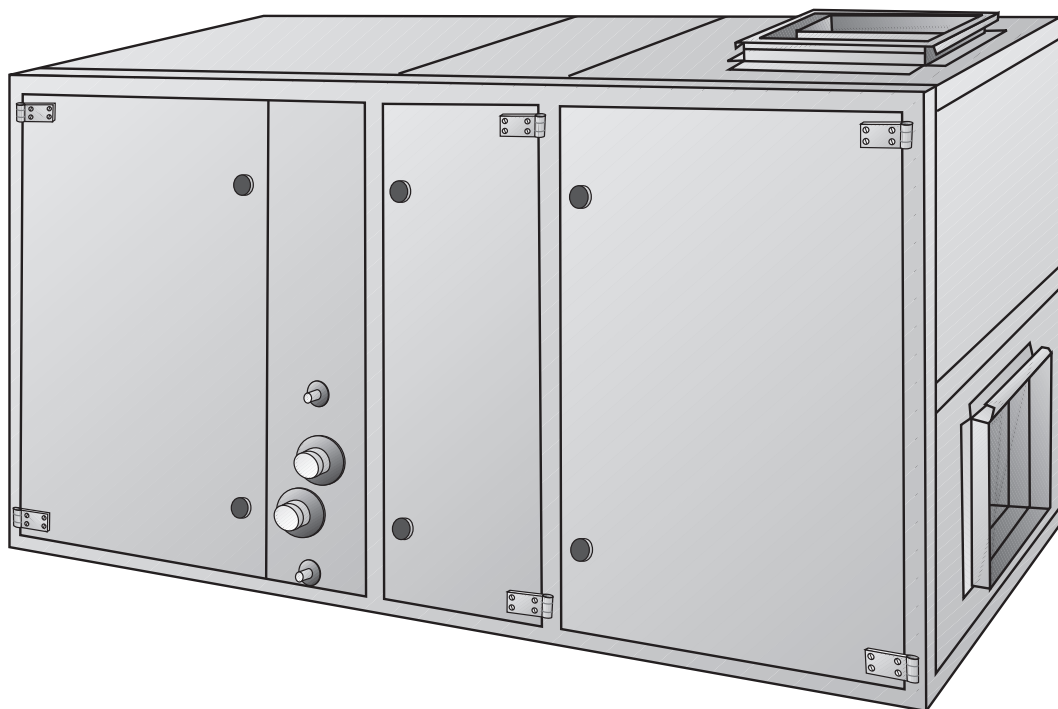

# FLEXOPAC Air conditioning unit

## General

The FLEXOPAC series is an air conditioning unit that permits effective and energy-efficient air conditioning in varying environments such as offices, workshops, homes, and schools.


The unit is available in two versions: the FLE, which is a heat recovery unit with supply and exhaust air, and the FLB, which is supplied as a block unit, and in addition to heat recovery can also be fitted with a cooling facility, recirculated air, and a flow measuring facility.

- Available in 5 sizes, with a flow range of 0,3-3,0 m<sup>3</sup>/s.
- Can be fitted with 3 different types of heat recovery unit, Heatbank with coolant 134A, rotor and plate heat exchanger.
- Has two basic models: the FLE unit assembly, and FLB block unit.
- The maximum dimension of 890 mm on each part of the unit allows transportation through narrow passages.
- Flexible construction provides the customer with a wide range of variants and versions to choose from.
- Four filter classes up to EU 7 can be selected.
- Can be supplied for outdoor installation.
- In combination with the KEA and KEAQ, a complete climate unit is achieved.


## Design

The units are made up of extruded aluminium profile frames. Doors, hatches and cover plates are manufactured from hot galvanized sheet steel. The interior unit walls are coated with sheet metal and insulated with 25 mm thick fire resistant mineral wool in the standard version, but they can also be manufactured with a type approved casing with fire resistance class A 30. All inspection hatches are fitted on hinges. In the standard version, the FLE unit assembly is supplied with a frame with a height of 150 mm.


Retractable fans featuring both forward and backward curved blades can be chosen. Rubber anti-vibration mountings effectively isolate fan vibration from the outlet. All belt pulleys are fitted with clamping bushings. The tightness class 3 is standard on the exterior air valve on the units. Supplementary information relating to the design and performance of the unit series is given on following pages in this section of the catalogue.

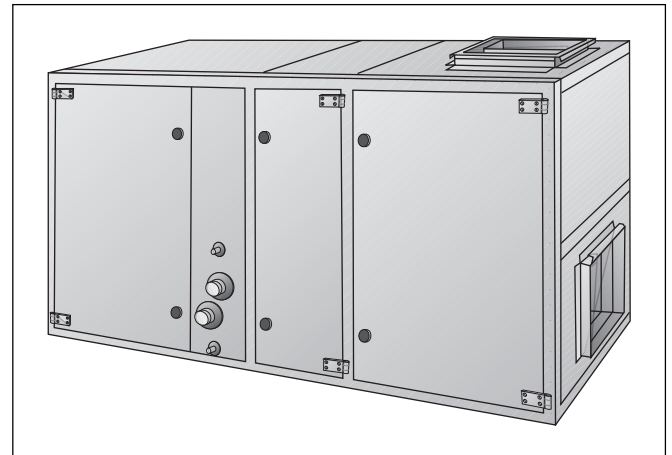

### Unit assembly FLE

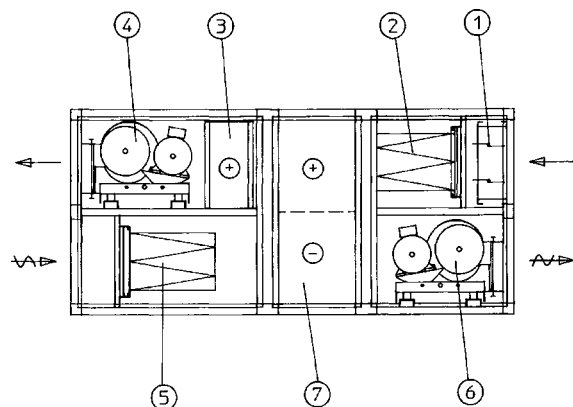

### Block unit FLB

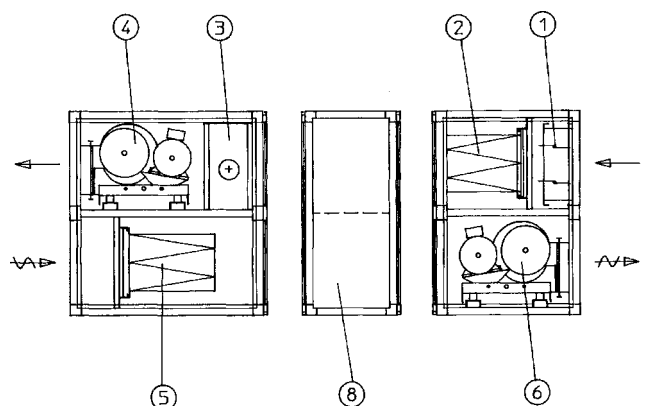

<b>Table of contents</b>	
<b>Unit assembly FLE</b>	<b>pages 4-5</b>
<b>Block unit FLB</b>	<b>pages 6-8</b>
<b>Heat recovery</b>	<b>pages 9-11</b>
<b>Technical data</b>	<b>pages 12-21</b>
<b>Functional units FLB</b>	<b>pages 22-24</b>
<b>Additional equipment</b>	<b>pages 25-26</b>
<b>Description text</b>	<b>page 27</b>

- |                      |                           |
|----------------------|---------------------------|
| 1. Supply air damper | 5. Exhaust air filter     |
| 2. Supply air filter | 6. Exhaust air fan        |
| 3. Air heater        | 7. Heat recovery unit     |
| 4. Supply air fan    | 8. Other functional units |

## Specification

Heat recovery unit

FLE -a-b-c-d

Size [ 055, 090, 150, 190, 300 ]

Casing [ 00 = Standard  
30 = A 30 ]

Design [ U 1-4, N 1-4  
S 1-4 ]

Inspection side\* [ H = Right  
V = Left ]

FAN

FLEB -a-e

Type [ F = Forward curved blades  
B = Backward curved blades  
L = Backward curved with guide vanes\*\* ]

Motor See page 57, Electric motors

Belt gear See page 63, Belt drive gear

FILTER

FLEF -a-f

Filter class [ 3 = EU 3 (G80)  
6 = EU 6 (F65)  
7 = EU 7 (F85)  
A = Aluminium mesh ]

AIR HEATER, WATER

FLEV -a-g

Power variant [ 1,2 ]

AIR HEATER, ELECTRICAL

FLEE -a-g-h-i

Power variant [ 1,2 ]

Type [ HT = High temperature  
LT = Low temperature ]

Air flow [ Min. air flow in m<sup>3</sup>/s ]

FAN

FLEB -a-e

Type [ F = Forward curved blades  
B = Backward curved blades  
L = Backward curved with guide vanes\*\* ]

Motor See page 57, Electric motors

Belt gear See page 63, Belt drive gear


FILTER

FLEF -a-f

Filter class [ 3 = EU 3 (G80)  
6 = EU 6 (F65)  
7 = EU 7 (F85)  
A = Aluminium mesh ]

\* Inspection side viewed in direction of supply air  
\*\* For sizes 190 and 300 only

## Version

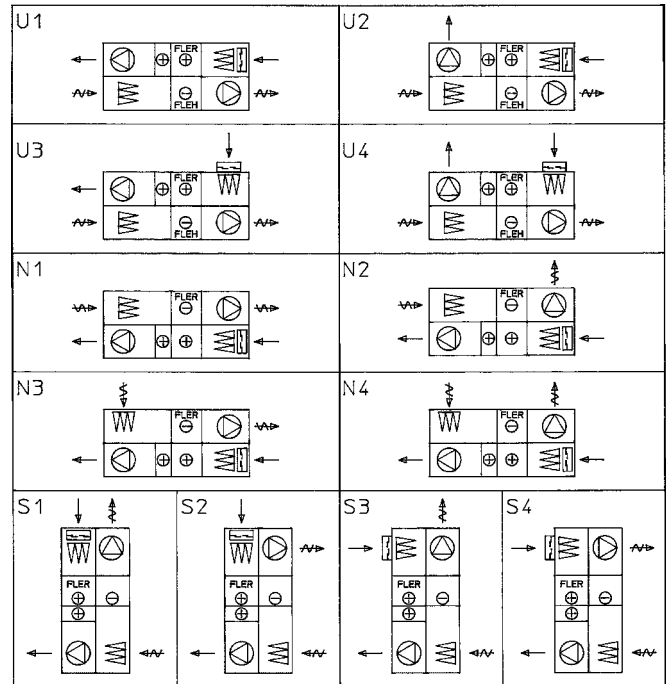


Version S 1-4 only applies to sizes 055 and 090 with heat recovery unit FLER (rotary). The unit with heat recovery unit FLEH (Heatbank) can only be supplied in version U 1-4.

## Additional equipment


- Outdoor version FLET-01 -a
- Connecting frames FLET-02 -a
- Exhaust air damper FLET-03 -a
- Sound attenuator FLET-04 -a
- Spacer FLET-05 -a
- Purging door, fan FLET-06 -a
- Electrical connection FLET-08 -a -m
- Version [ P = To terminal block  
A = To installed cabinet ]

- Fabric duct connection FLET-09-a
- Glass in inspection hatch FLET-11
- Reinforced fan FLET-12-300

Heat recovery units FLER and FLEH are specified as per the chart on pages 9-10.



## Dimensions and weights

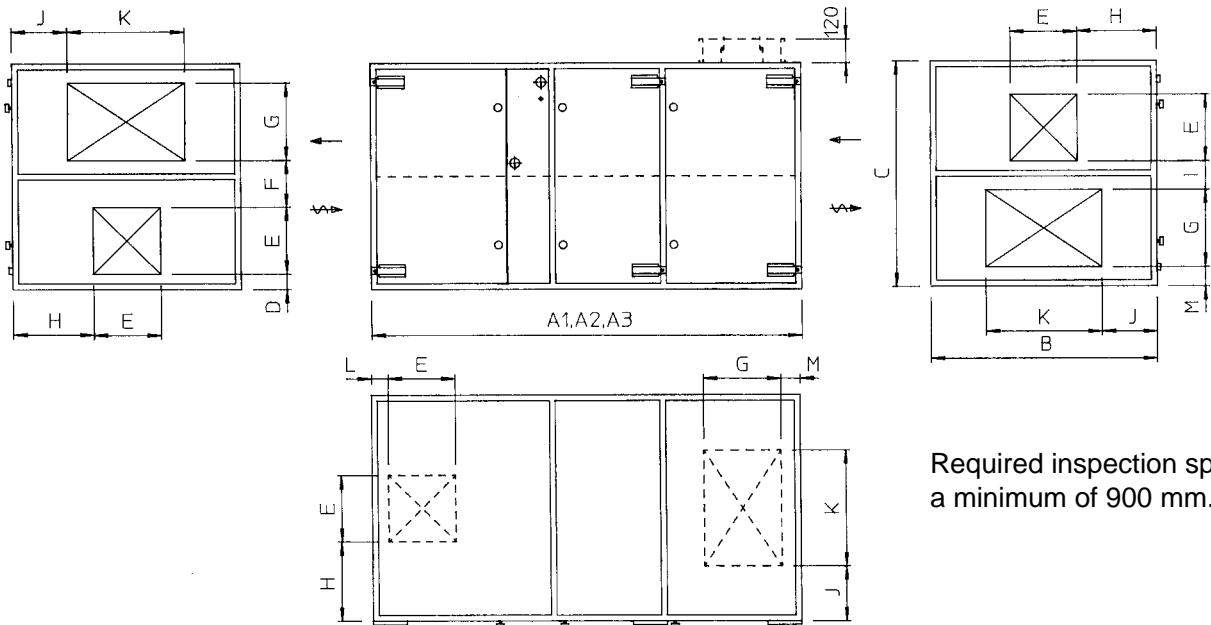

Required inspection space, a minimum of 900 mm.

Vers.	Size	A <sub>1</sub>	A <sub>2</sub>	A <sub>3</sub>	B	C	D	E	F	G	H	I	J	K	L	M	Weight*			Max. motor inst. size
																	V <sub>1</sub> kg	V <sub>2</sub> kg	V <sub>3</sub> kg	
Standard	055	1725	1945	2150	850	850	80	225	175	300	310	120	275	300	85	70	210	250	310	80
	090	1860	2080	2280	980	980	80	275	220	300	430	150	290	400	85	100	270	315	385	100
	150	1990	2210	2415	1170	1170	80	345	245	400	470	150	285	600	85	100	360	430	540	112
	190	2150	2370	2575	1325	1325	80	380	325	400	470	190	265	800	85	140	450	550	700	112
	300	2285	2505	2710	1575	1575	80	475	370	500	550	200	290	1000	85	150	580	735	945	132
A 30	055	1790	2010	2215	885	915	115	225	175	300	335	120	300	300	120	105	260	305	370	80
	090	1925	2145	2345	1015	1045	115	275	220	300	455	150	315	400	120	135	340	385	460	100
	150	2055	2275	2480	1205	1235	115	345	245	400	495	150	310	600	120	135	435	510	625	112
	190	2215	2435	2640	1360	1390	115	380	325	400	495	190	290	800	120	175	550	655	810	112
	300	2350	2570	2775	1610	1640	115	475	370	500	575	200	315	1000	120	185	700	865	1080	132

\* Weight excluding motors

A<sub>1</sub> V<sub>1</sub> = Dimension and weight with rotor. A<sub>2</sub> V<sub>2</sub> = Dimension and weight with single Heatbank


A<sub>3</sub> V<sub>3</sub> = Dimension and weight with double Heatbank

## Outdoor version FLET-01, FLBT-01


In the U1, U5, PN01, and PN05 versions, the FLE and FLB units can be supplied for outdoor installation. When mounted on roof, the unit is placed on a rim or support strut above a compact outer roof. In the outdoor version, the unit is supplemented with a roof, bottom frame, outer wall grille, exhaust hood, and the required number of seals. See diagram.

L = total external length of unit +5 mm

B = exterior width of unit +5 mm

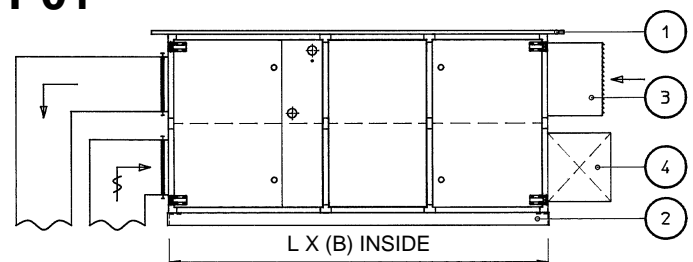

1. Roof
2. Bottom frame
3. Outer wall grille
4. Exhaust hood




## Unit overview, FLB

### General

FLB is the designation of the Flexopac unit when it is supplied in the block version. The block model consists of a supply and an exhaust air section.

In order to comply with other air conditioning requirements, the unit can be supplemented with functional units indicated in the table below.

## Dimensions and weights

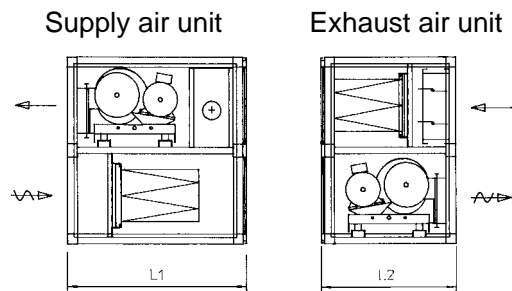

Size	Version	Standard						A 30						Weight*					
		L <sub>1</sub>	L <sub>2</sub>	L <sub>1</sub> +L <sub>2</sub>	L <sub>1</sub>	L <sub>2</sub>	L <sub>1</sub> +L <sub>2</sub>	Standard			A 30								
								V <sub>1</sub> kg	V <sub>2</sub> kg	V <sub>1</sub> +V <sub>2</sub> kg	V <sub>1</sub> kg	V <sub>2</sub> kg	V <sub>1</sub> +V <sub>2</sub> kg						
055	U 1-4, N 1-4	820	615	1435	855	650	1505	90	60	150	110	80	190						
	U 5-8, N 5-8	615	615	1230	650	650	1300	55	60	115	75	80	155						
090	U 1-4, N 1-4	890	680	1570	925	715	1640	115	80	195	140	100	250						
	U 5-8, N 5-8	680	680	1360	715	715	1430	75	80	155	95	100	195						
150	U 1-4, N 1-4	960	740	1700	995	775	1770	155	110	265	190	135	325						
	U 5-8, N 5-8	740	740	1480	775	775	1550	100	110	210	125	135	260						
190	U 1-4, N 1-4	1040	820	1860	1075	855	1930	195	140	335	240	175	415						
	U 5-8, N 5-8	820	820	1640	855	855	1710	125	140	265	160	175	335						
300	U 1-4, N 1-4	1105	890	1995	1140	925	2065	255	185	440	310	230	540						
	U 5-8, N 5-8	890	890	1780	925	925	1850	165	185	350	210	230	440						

Other dimensions are given in the table on page 3.


\* Weight excluding motor V<sub>1</sub> = Weight of supply air unit; V<sub>2</sub> = Weight of exhaust air unit

## Functional units

Designation		Heat recovery unit FLBH	Heat recovery unit FLBR	Heat recovery unit FLBP	KEA KEAQ*	Air heater unit FLBL	Air cooler unit FLBK	Recirculated air unit FLBB	
Length (L)		Single = 630 Double = 835	410	Size 055= 835 090=1120 150=1200 190=1200 300=1460	Size 150=975 190=1055 300=1120	Water heater= 330 Electric heater= 410	Short= 330 Long = 630	545	
Weight (kg)		Size	Single	Double			Short	Long	
Standard	055	100	160	60	95	–	40	60	85
	090	120	190	75	130	–	50	80	100
	150	165	275	95	170	410	65	100	130
	190	215	365	115	200	470	85	120	160
	300	295	505	140	285	580	100	150	190
A 30	055	115	180	70	110	–	50	70	100
	090	135	210	90	160	–	65	95	120
	150	185	300	110	210	460	80	115	150
	190	240	395	135	245	530	105	140	185
	300	325	540	160	350	670	120	170	220
Technical data, page		10		9	11	49/53	18-19	20-21	22

\*KEA = Cooling unit

KEAQ= Cooling unit with heat recovery



## Functional units

Designation		Measuring unit FLBD	Media unit FLBM	Inspection unit FLBI	
Length (L)		330	755	Short = 330 Long = 630	
Weight (kg)	Standard	Size		Short Long	
		055 090 150 190 300	30 35 40 50 60	115 140 170 195 225	25 50 30 60 35 70 40 80 45 90
	A 30	055 090 150 190 300	35 45 55 65 75	140 170 205 235 270	35 70 40 80 45 90 50 100 60 120
Technical data, page		23	24	24	

### Specification

**BLOCK UNIT**

Size [ 055, 090, 150, 190, 300 ]

Casing [ 00 = Standard  
30 = A 30 ]

Version [ U 1-8, PU 01-16  
N 1-8, PN 01-16 ]

See page 8

Inspection side\* [ H = Right  
V = Left ]

**FAN**

Type [ F = Forward curved blades  
B = Backward curved blades  
L = Backward curved with guide vanes\*\* ]

Motor [ See page 57, Electric motors ]

Belt gear [ See page 63, Belt drive gear ]

**FILTER**

Filter class [ 3 = EU 3 (G80)  
6 = EU 6 (F65)  
7 = EU 7 (F85)  
A = Aluminium mesh ]

**AIR HEATER, WATER**

Power variant [ 1, 2 ]

**AIR HEATER, ELECTRICAL**

Power variant [ 1, 2 ]

Type [ HT = High temperature  
LT = Low temperature ]

Air flow [ Min. air flow in m<sup>2</sup>/s ]

**AIR COOLER**

Cooling system [ VK = Water cooler  
DX = DX cooler ]

Power variant [ 1, 2, 3 ]

Droplet separator [ 0 = Without  
1 = With ]

Supply air flow

Exhaust air flow

**Exhaust air flow**

FAN

Type [ F = Forward curved blades  
B = Backward curved blades  
L = Backward curved with guide vanes\*\* ]

Motor [ See page 57, Electric motors ]

Belt gear [ See page 63, Belt drive gear ]


**FILTER**

Filter class [ 3 = EU 3 (G80)  
6 = EU 6 (F65)  
7 = EU 7 (F85)  
A = Aluminium mesh ]

\* Inspection side viewed in direction of supply air  
\*\* For sizes 190 and 300 only



## Additional equipment

- Outdoor version FLBT-01 -a
- Connecting frames FLET-02 -a
- Exhaust air damper FLET-03 -a
- Sound attenuator FLET-04 -a
- Spacer FLET-05 -a
- Purging door, fan FLET-06 -a
- Frame FLBT-07 -a
- Electrical connection FLBT-08 -a -m
- Version [ P= To terminal block  
A= To installed cabinet ]
- Fabric duct connection FLET-09-a
- Flowmeter FLET-10
- Glass in inspection hatch FLET-11
- Reinforced fan FLET-12-300





## Version


Versions U1-U8 apply to units with FLBH (Heat-bank) heat recovery unit. Versions U1-U8, N1-N8 apply to units with FLBR (rotary) heat recovery unit and also KEA and KEAQ.

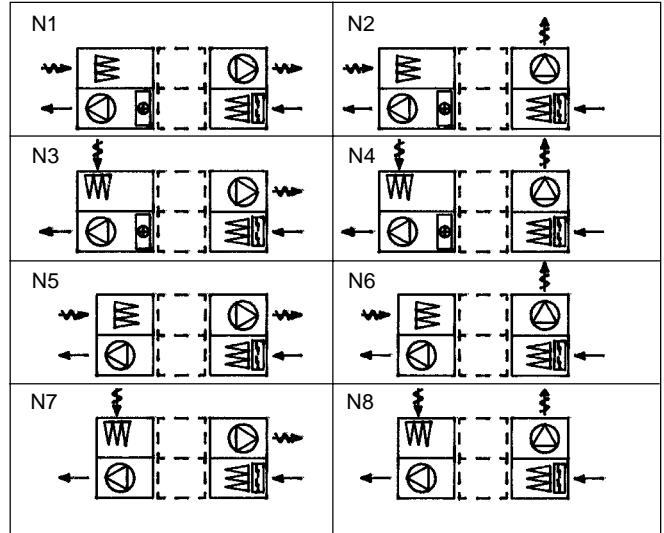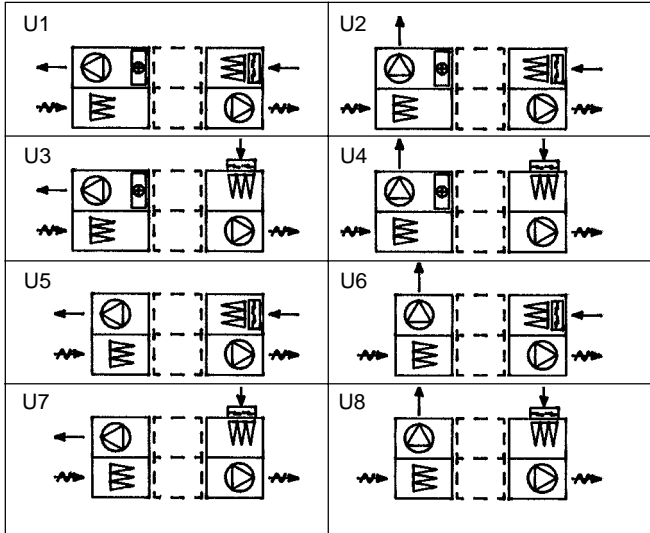

The versions indicated below apply to units with an FLBP (plate heat exchanger) heat recovery unit.

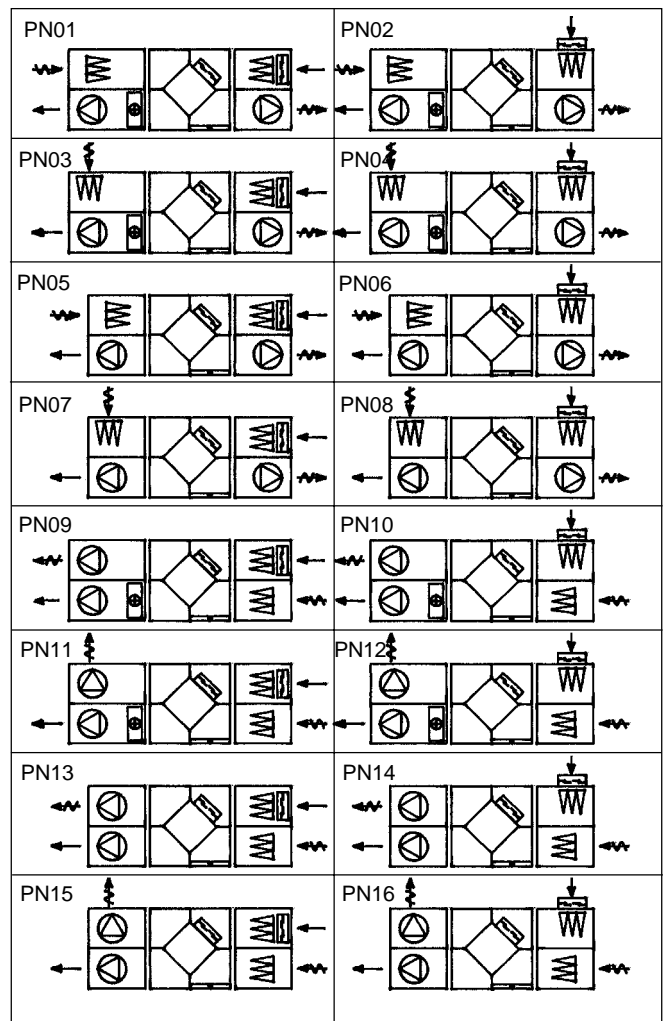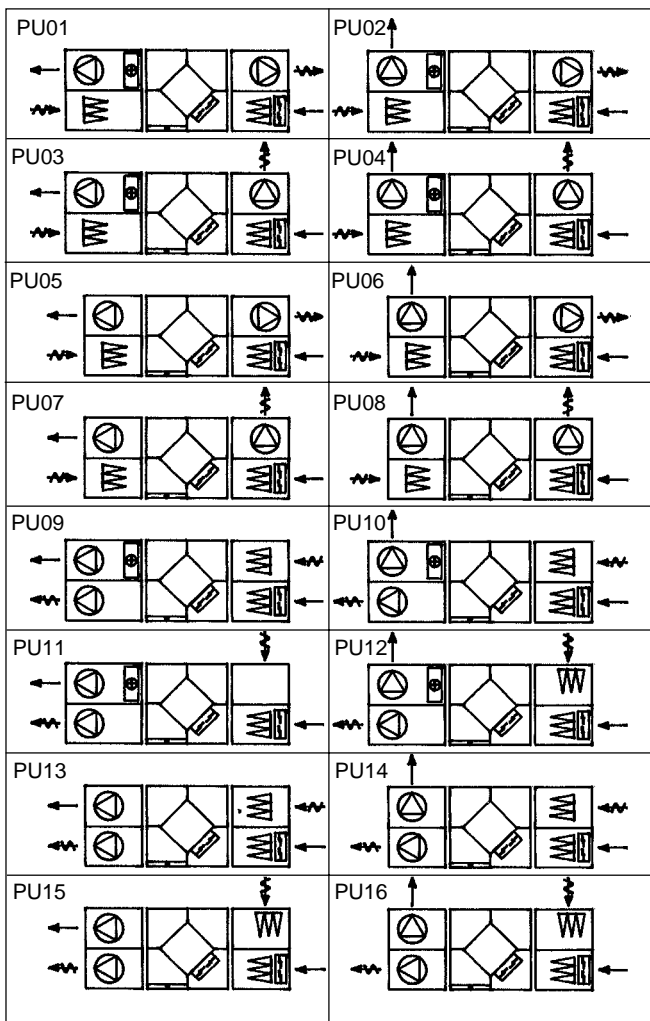






## Heat recovery units FLER and FLBR


### Description

The FLER and FLBR heat recovery units are of the rotary type. The rotor is assembled from alternate layers of flat and corrugated thin sheet aluminium. A purging sector ensures continuous cleaning of the rotor. An "on/off" drive system can be selected, or,

### Technical data

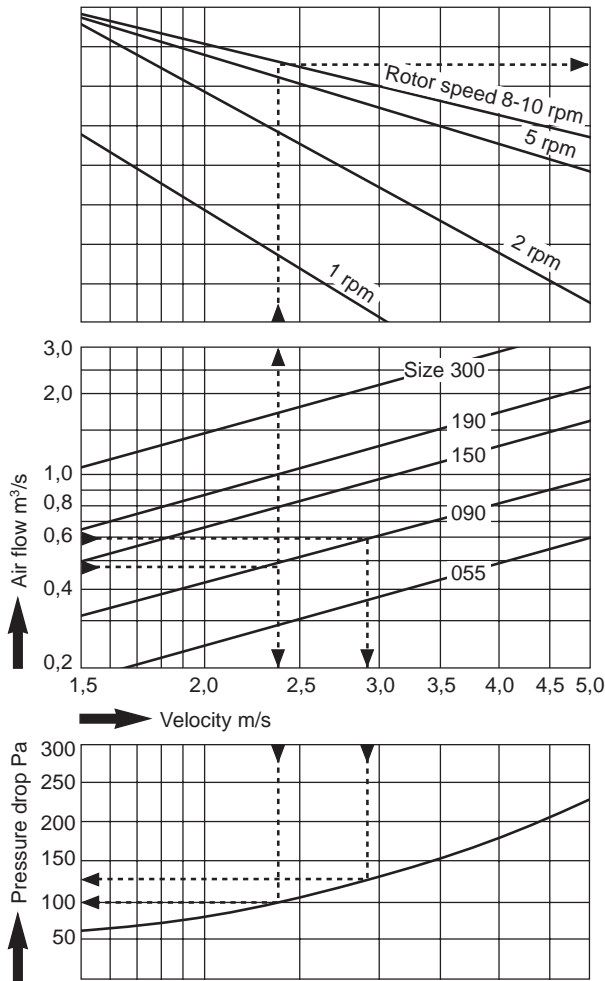

when there are high demands on the control of transmitted power, there is electronic equipment available for the control of the rotor speed. When there are high demands on moisture transmission, the rotor can be supplied with hygroscopic treatment.

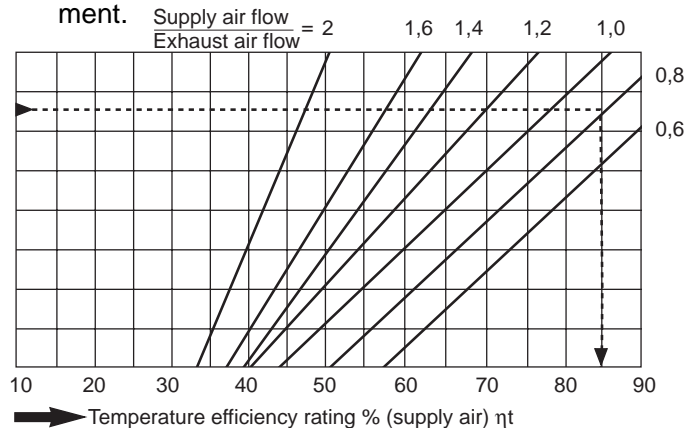

### Example:

#### Given:

Supply air flow 0,48 m/s  
Exhaust air flow 0,60 m³/s  
Size 090 10 r/m

#### The charts give:

Temperature efficiency rating (supply air) = 85 %  
Pressure drop (supply air) = 100 Pa  
Pressure drop (exhaust air) = 130 Pa

### Specification

#### HEAT RECOVERY UNIT

		-a-b-c-d-e
For installation in	FLEH= Unit assembly FLBH=Block assembly	
Size	055, 090, 150, 190, 300	
Casing	00=Standard 30=A-30	
Rotor	NO=Normal HY=Hygroscopic	
Drive unit	K=Constant speed R=Speed control	

### Motordata


Vers	Size	Power W	Voltage type	Rated current/Fuse
Const. speed 10 r/min	055 - 090	45	3 x 380 V	0,22 A
	150 - 190	120	3 x 380 V	0,33 A
	300	180	3 x 380 V	0,72 A
Speed control	055 - 090	30	1 x 220 V	2 A Delay
	150 - 300	90	1 x 220 V	6 A Delay



## Heat recovery units FLEH and FLBH



### Description

The FLEH and FLBH heat recovery units are of the Heatbank heat pipe exchanger type. Single or double heat recovery units with a fin pitch of 1,8 mm can be selected for comfort installations. In the case of installations in industrial environments, where there is polluted exhaust air, the industrial version should always be used. This version has a fin pitch of 2,8 mm on the exhaust air side. A corrosion-resistant drip tray with drain connections is provided to collect condensation water. Defrosting and power regulation is performed with the help of integrated by-pass and shut-off damper connected to a common drive shaft. Refrigerant: AFC 134 A (Tetrafluoroethane)

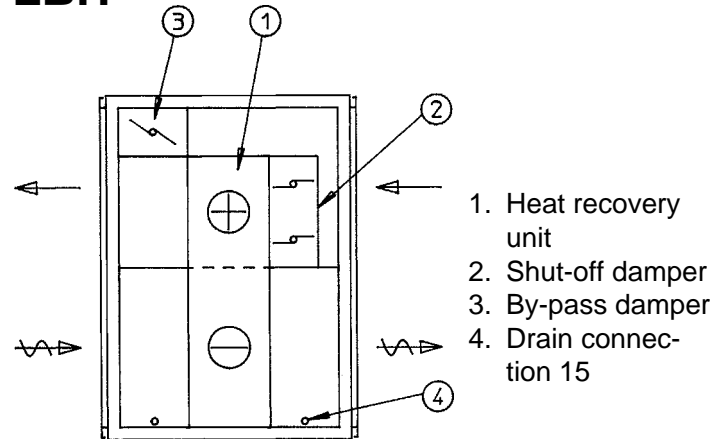

1. Heat recovery unit
2. Shut-off damper
3. By-pass damper
4. Drain connection 15

### Technical data

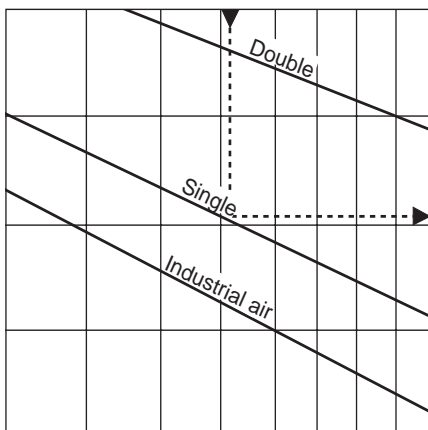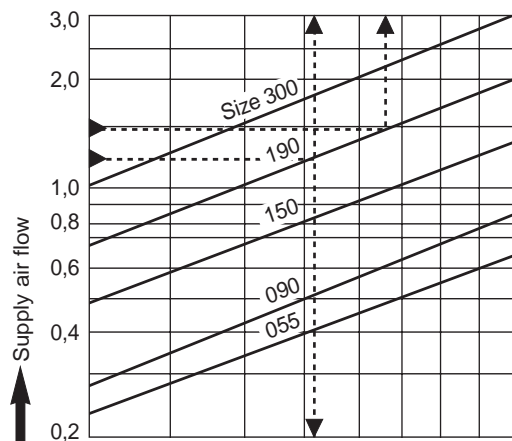

### Specification


HEAT RECOVERY UNIT		-a -b -c -d
For installation in	FLEH = Unit assembly FLBH = Block unit	
Size	055, 090, 150, 190, 300	
Casing	00 = Standard 30 = A-30	
Version	E = Single D = Double I = Industrial version	

### Example:


Supply air flow = 1,2 m<sup>3</sup>/s  
Exhaust air flow = 1,5 m<sup>3</sup>/s  
Size 190, single

#### The charts give:

Temperature efficiency rating (supply air) 66%  
Pressure drop (supply air) 95 Pa  
Pressure drop (exhaust air) 130 Pa

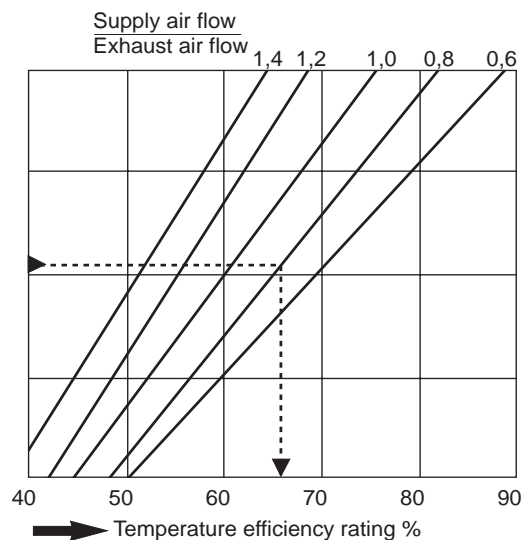


Temperature efficiency rating %  
We reserve the right to make changes without prior notice



## Heat recovery unit FLBP




### Description

The FLBP heat recovery unit is a unit that contains a cross-current type of plate heat exchanger. Defrosting and power regulation are performed with the help of the integrated by-pass and shut-off valves. A corrosion-resistant drip tray with drain connections is provided to collect condensation water.

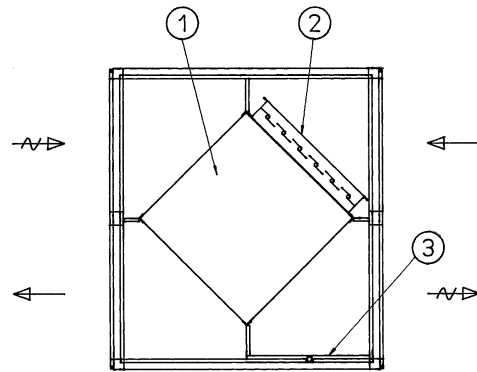


- 1. = Heat recovery unit
- 2. = By-pass and shut-off valves
- 3. = Drip tray with drain connection 15

### Technical data

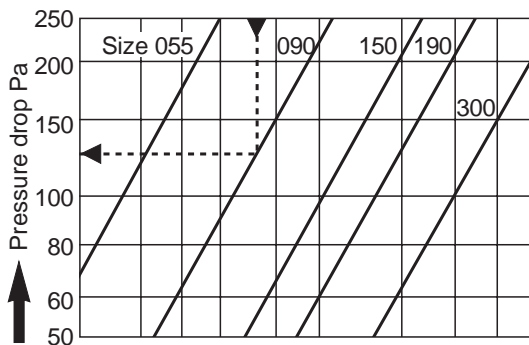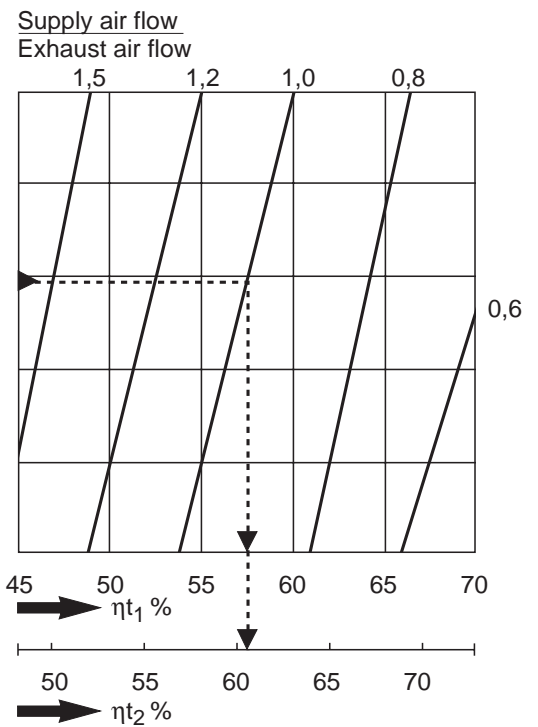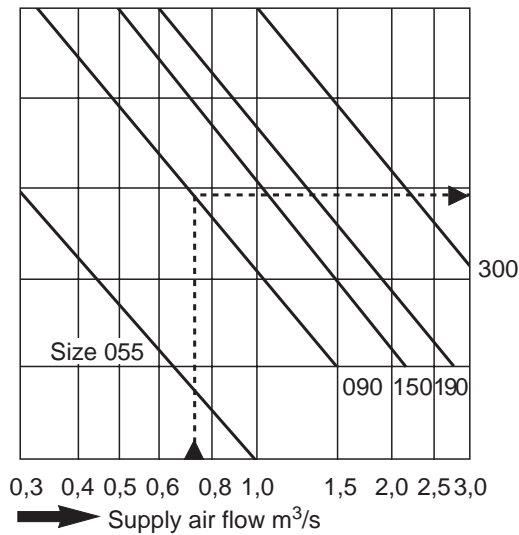


$\eta_{t1}$  = Dry temp. efficiency rating  
 $\eta_{t2}$  = Temp. efficiency rating at exhaust air +20, 30% RH, and an outdoor air temperature of -10°C.

### Version

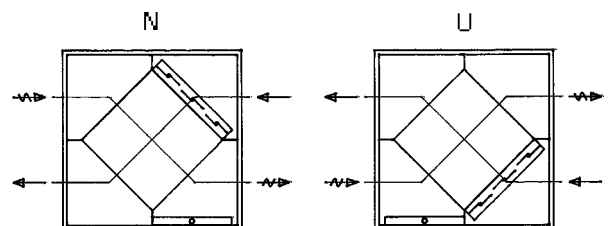




### Specification

HEAT RECOVERY UNIT		FLBP-a-b-c
Size	055, 090, 150, 190, 300	a
Casing	00=Standard 30=A30	b
Version	U or N	c



# Fan capacity

## FLEB-055-F

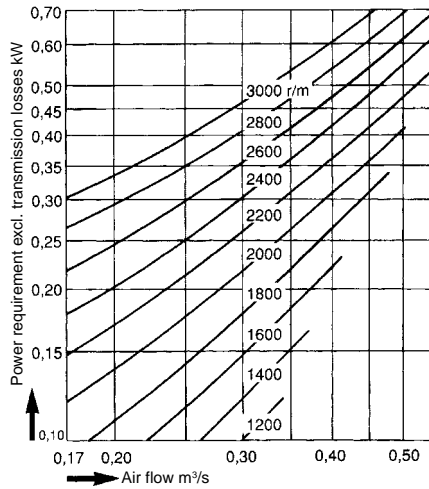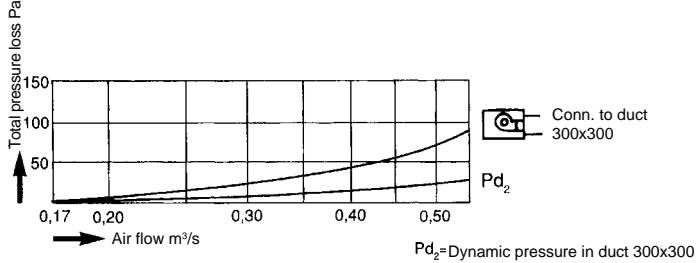
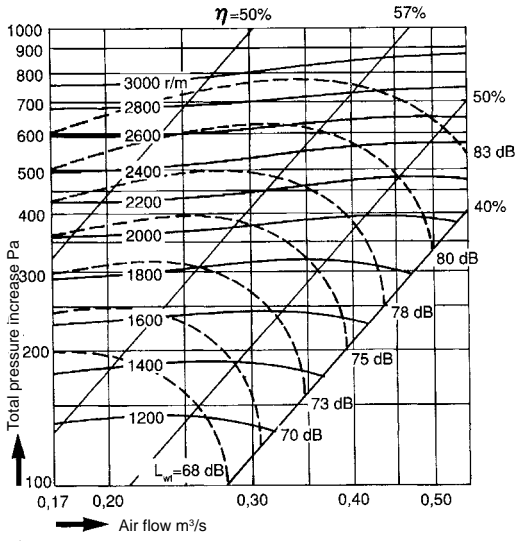


### Sound data\*


For dividing octave bands, add a correction  $K_{ok}$  to the value  $L_{wt}$  derived from the table

Middle frequency Hz	63	125	250	500	1000	2000	4000	8000
Correction $K_{ok}$ duct	-4	-8	-9	-11	-11	-12	-14	-19
Correction $K_{ok}$ fan compartment	-21	-19	-23	-34	-34	-35	-40	-44

## FLEB-090-F

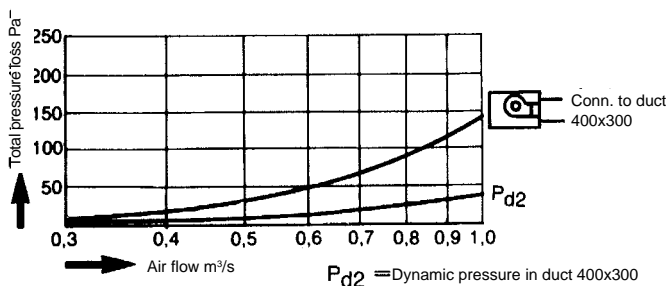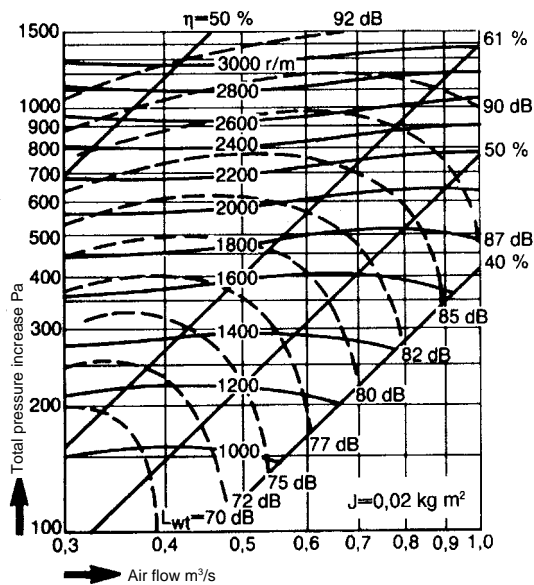

### \* According to ISO

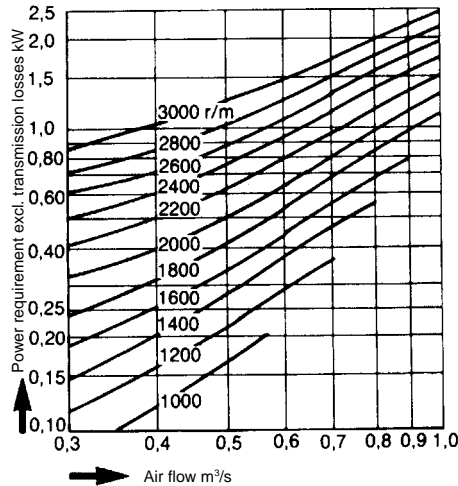


### Sound data\*




For dividing octave bands, add a correction  $K_{ok}$  to the value  $L_{wt}$  derived from the table

Middle frequency Hz	63	125	250	500	1000	2000	4000	8000
Correction $K_{ok}$ duct	-4	-8	-9	-11	-11	-12	-14	-19
Correction $K_{ok}$ fan compartment	-21	-19	-23	-34	-34	-35	-40	-44

### \*According to ISO



## FLEB-150-F

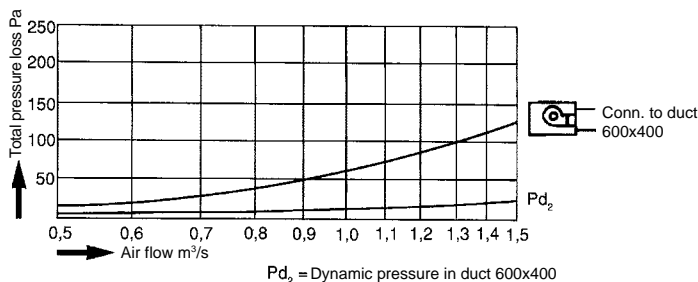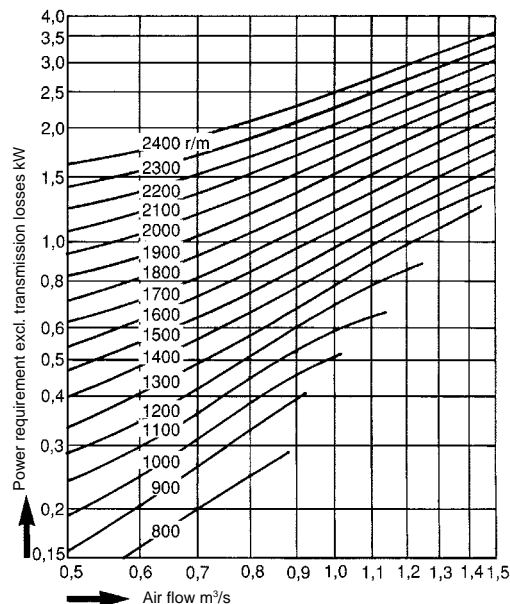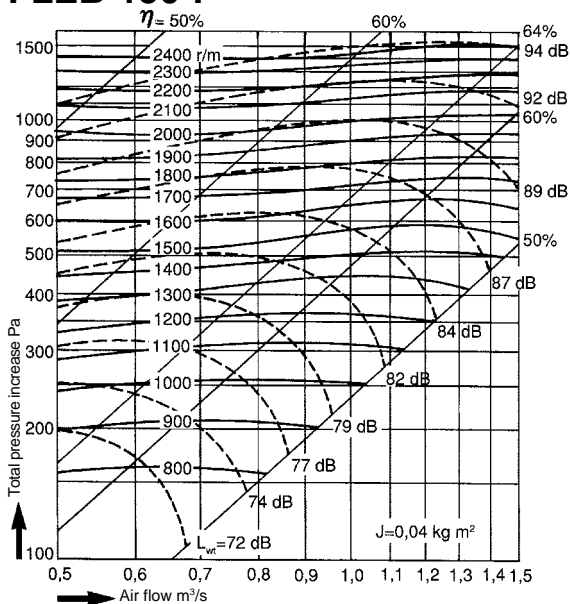


### Sound data\*



For dividing octave bands, add a correction  $K_{ok}$  to the value  $L_{wt}$  derived from the table

Middle frequency Hz	63	125	250	500	1000	2000	4000	8000
Correction $K_{ok}$ duct	-3	-9	-10	-10	-11	-14	-16	-21
Correction $K_{ok}$ fan compartment	-20	-19	-23	-33	-34	-38	-42	-48

## FLEB-150-B

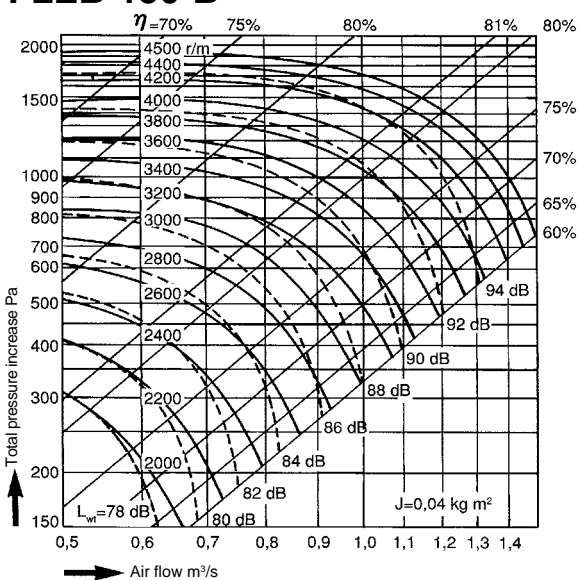

### \*According to ISO

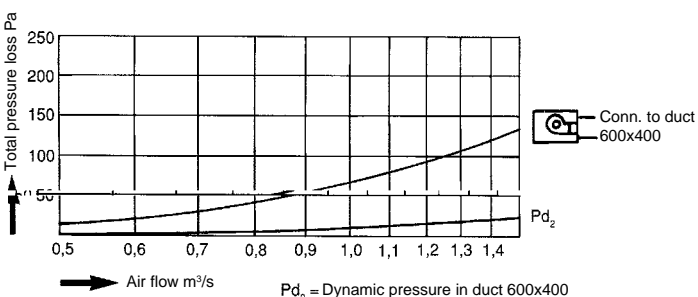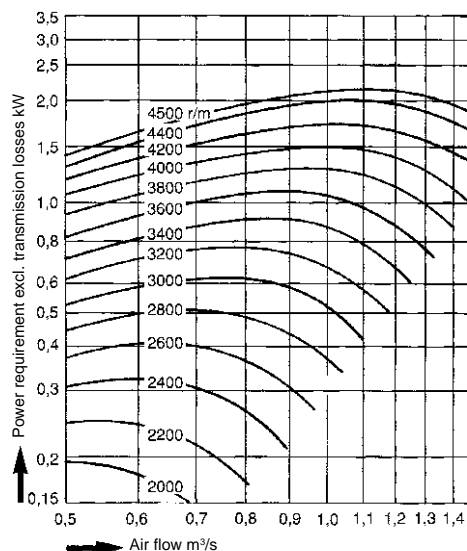

### Sound data\*



For dividing octave bands, add a correction  $K_{ok}$  to the value  $L_{wt}$  derived from the table

Middle frequency Hz	63	125	250	500	1000	2000	4000	8000
Correction $K_{ok}$ duct	-8	-7	-11	-6	-7	-9	-14	-18
Correction $K_{ok}$ fan compartment	-18	-22	-27	-30	-33	-34	-39	-45

### \*According to ISO

## Fan capacity

### FLEB-190-F

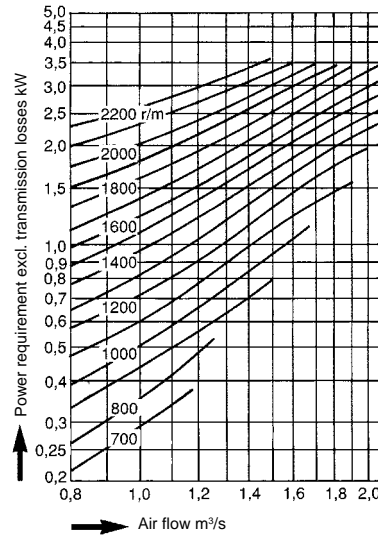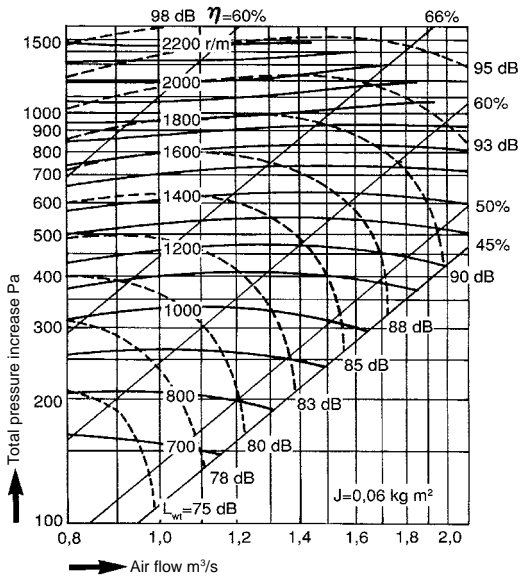


#### Sound data\*



For dividing octave bands, add a correction  $K_{ok}$  to the value  $L_{wt}$  derived from the table

Middle frequency Hz	63	125	250	500	1000	2000	4000	8000
Correction $K_{ok}$ duct	-3	-9	-10	-10	-11	-14	-16	-21
Correction $K_{ok}$ fan compartment	-20	-19	-23	-33	-34	-38	-42	-48

\*According to ISO

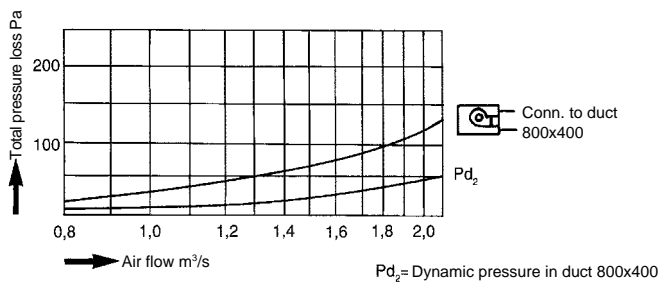

### FLEB-190-B

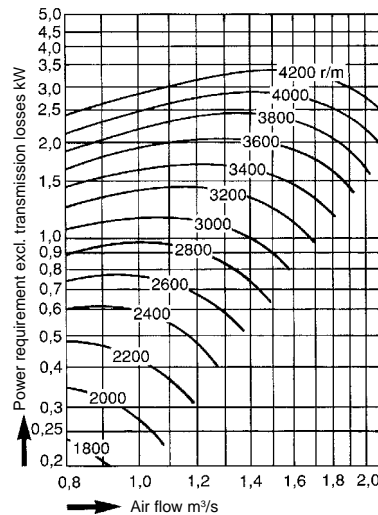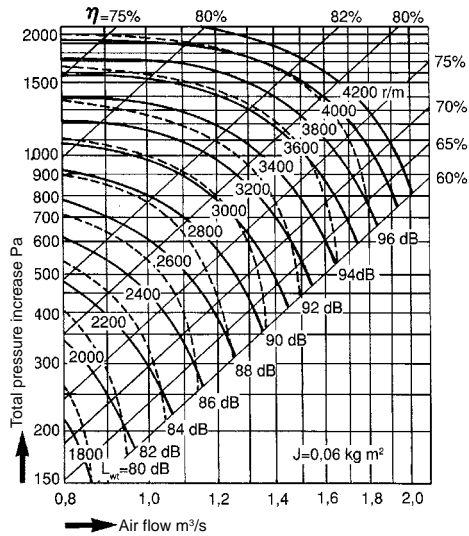



#### Sound data\*

For dividing octave bands, add a correction  $K_{ok}$  to the value  $L_{wt}$  derived from the table




Middle frequency Hz	63	125	250	500	1000	2000	4000	8000
Correction $K_{ok}$ duct	-8	-7	-11	-6	-7	-9	-14	-18
Correction $K_{ok}$ fan compartment	-18	-22	-27	-30	-33	-34	-39	-45

\*According to ISO

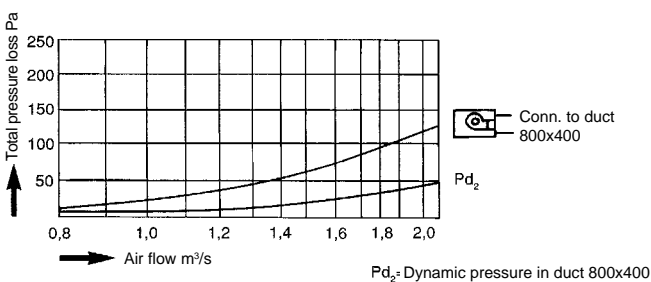



## Fan capacity FLEB-300-F

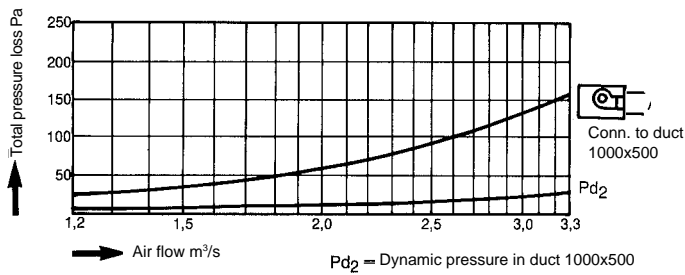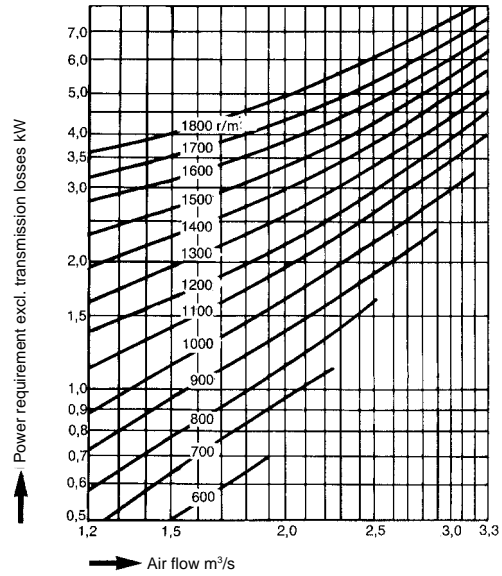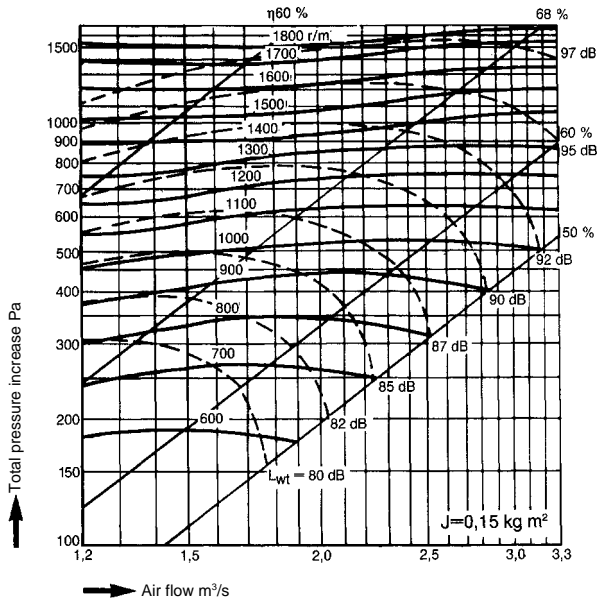




### Sound data\*

For dividing octave bands, add a correction  $K_{ok}$  to the value  $L_{wt}$  derived from the table

Middle frequency Hz	63	125	250	500	1000	2000	4000	8000
Correction $K_{ok}$ duct	-3	-9	-10	-10	-11	-14	-16	-21
Correction $K_{ok}$ fan compartment	-20	-19	-23	-33	-34	-38	-42	-48

\*According to ISO

## FLEB-300-B

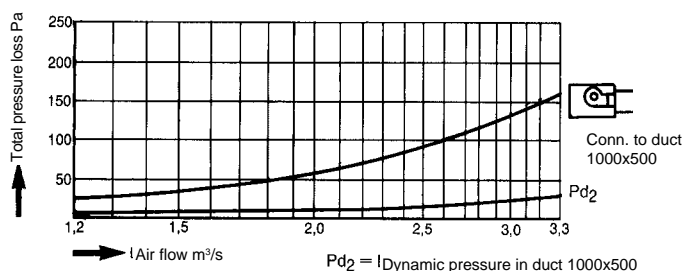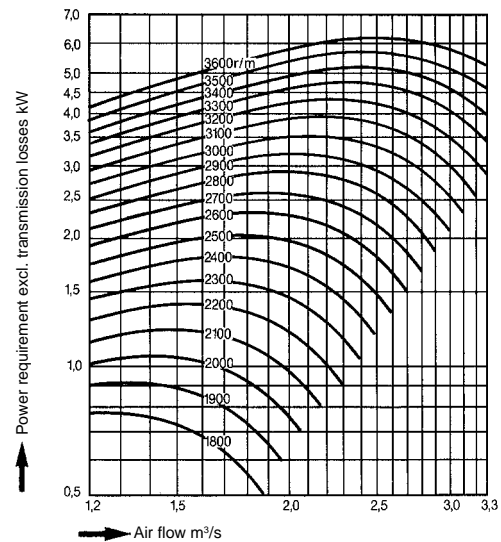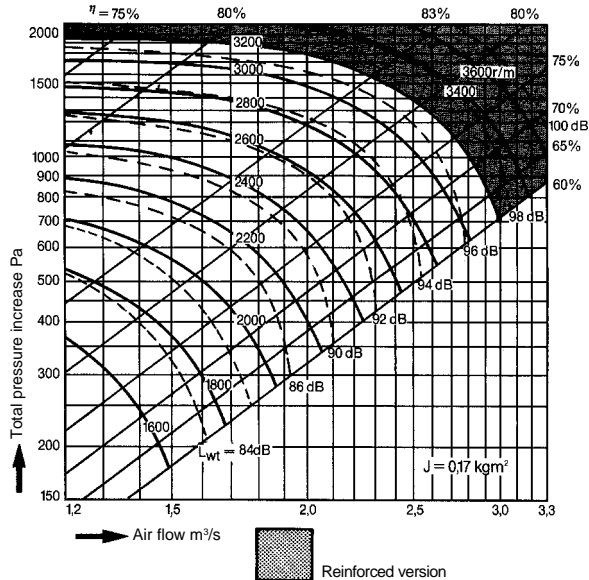


### Sound data\*

For dividing octave bands, add a correction  $K_{ok}$  to the value  $L_{wt}$  derived from the table

Middle frequency Hz	63	125	250	500	1000	2000	4000	8000
Correction $K_{ok}$ duct	-8	-7	-11	-6	-7	-9	-14	-18
Correction $K_{ok}$ fan compartment	-18	-22	-27	-30	-33	-34	-39	-45

\*According to ISO





## Filter FLEF

### Description




The FLEF filter is available in 4 different grades. In addition to deep-folded disposable bags in the EU3, EU6, and EU7 classes, a cleanable aluminium filter can be selected. This should be used particularly in installations in which the exhaust air contains greasy substances, such as found in ventilation systems in homes.

In the standard version, delivery of the unit includes a U-tube manometer for monitoring the filter.

### Technical data



#### EU 3 (G80)

The filter is a deep-folded disposable filter that cannot be cleaned and is made of polyamide fibres.

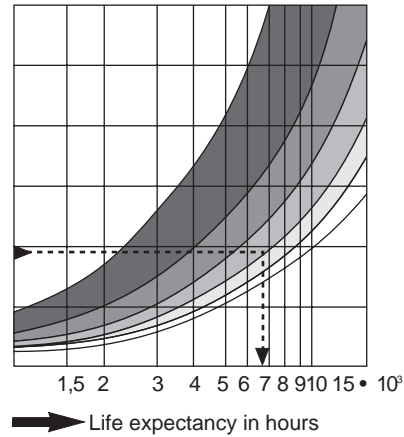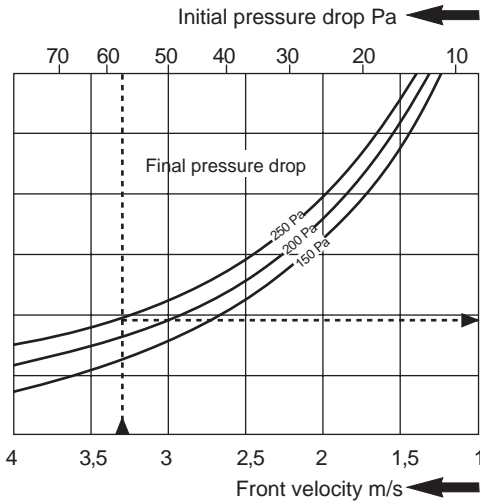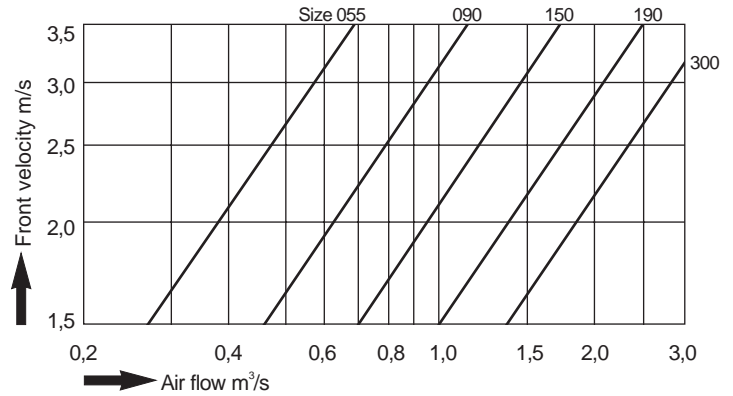

#### EU 6 (F65)

The filter is a deep-folded disposable filter that cannot be cleaned and is made of fibreglass.

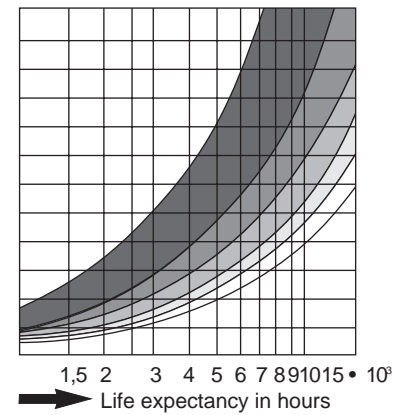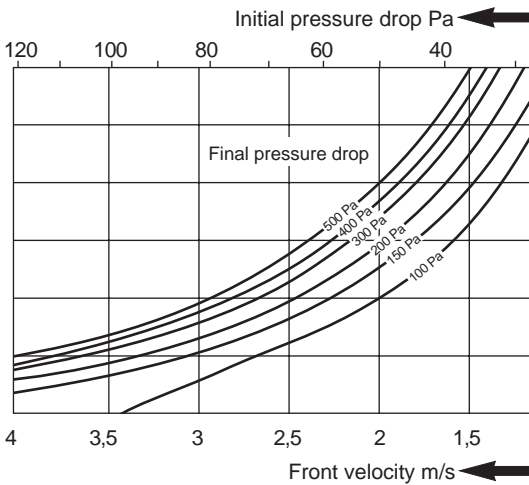


Applications

- Industrial area
- Industrial town
- City
- Rural town
- Countryside



We reserve the right to make changes without prior notice





## EU 7 (F85)


The filter is a deep-folded disposable filter that cannot be cleaned and is made of fibreglass.

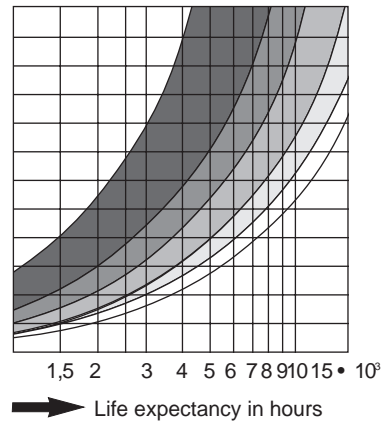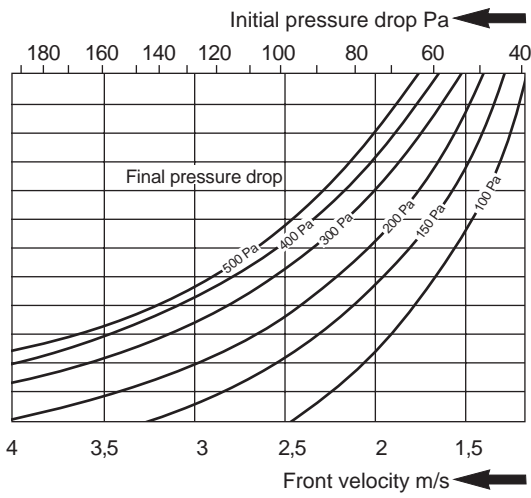


## Aluminium mesh filter

The filter is a panel filter made of aluminium mesh, and is cleanable.

The recommended final pressure drop is 150 Pa

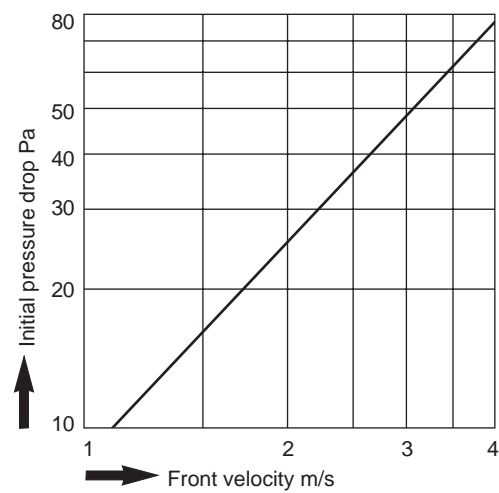



# Air heater FLEV

## Design


The FLEV air heater is a fin-type heat exchanger for heating with hot water. The coil body consists of copper pipes and aluminium fins.

The collection pipes have an external thread and are fitted with outlets for ventilation and draining. A freeze monitor can be connected to a plunger sensor with a maximum diameter of Ø5 mm.

## Connection dimension:

Size 055-150 conn. 25  
Size 190-300 conn. 32

## Technical data

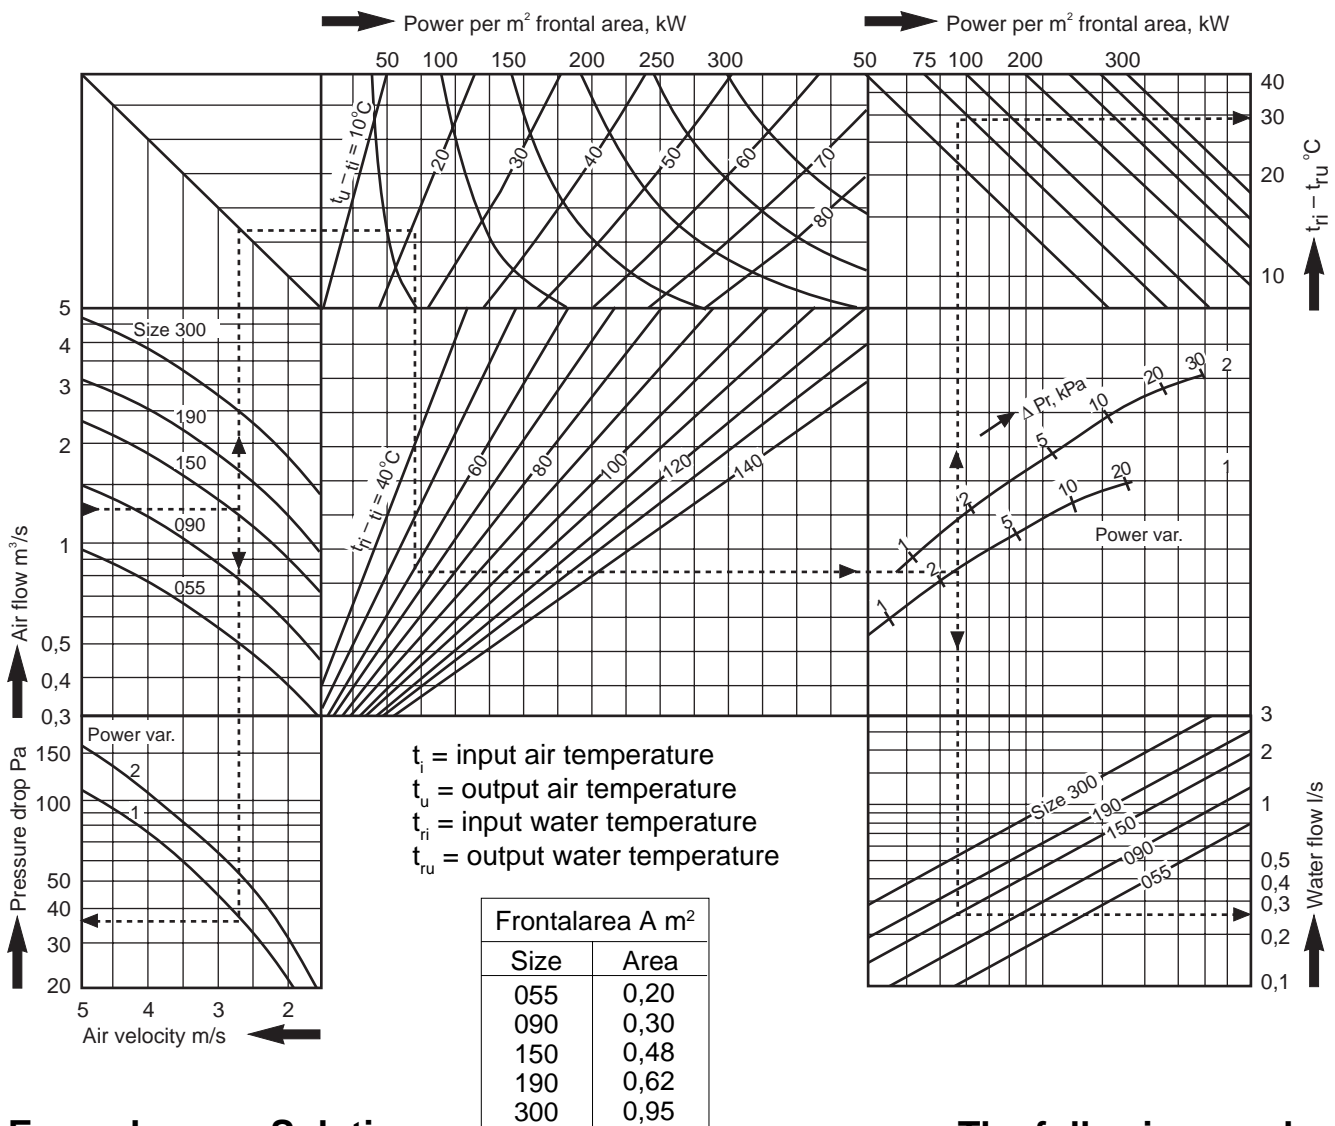

## Example:


Given:  
Airflow = 1,3 m<sup>3</sup>/s  
t<sub>i</sub> = ± 0 °C  
t<sub>u</sub> = + 20 °C  
t<sub>ri</sub> = + 60 °C  
t<sub>ru</sub> = + 40 °C  
Size 150

## Solution:

Read off the chart with flow 1.3 m<sup>3</sup>/s  
Select size 150  
Follow the dashed line.  
At t<sub>u</sub>-t<sub>i</sub> = 20°C, the power will be 65 kW per m<sup>2</sup> frontal area.  
Move to the "break-off" line t<sub>ri</sub>-t<sub>i</sub> 60°C and on to the dimensioning curve for power variant 1.  
Check the upper chart to make sure t<sub>ri</sub>-t<sub>ru</sub> exceeds the dimensioned data. If it does not, power variant 2 must be used.

## The following can be obtained from the chart:

Power variant = 1  
Water flow = 0.26 l/s  
Pressure drop Pr = 2.5 kPa  
t<sub>ri</sub>-t<sub>ru</sub> = 29 °C (which means that the return temp. is 60-29 = 31°C)  
Pressure drop, air = 38 Pa



## Air heater FLEE

### Design

The FLEE air heater is an electric heater in a low or a high temperature version.

In the low temperature version, the heating surface consists of aluminium fins with a pitch of 3.2 mm and copper pipes in which element rods are inserted.

The high temperature version consists of stainless steel pipe elements.

The heaters feature double overheating protectors, one of which is reset manually, that switch-off the power supply in a risk of overheating-situation.


Protection form S 32 in accordance with SEN 2121. There are standard air heaters with 2 power variants to each size. Other power variants can be supplied, however, according to specification.

### Power division

Size	Power stage	
	Variante 1 kW	Variante 2 kW
055	8	13
090	13	7+15=22
150	7+15=22	2,4+4,8+9,6+19,2=36
190	1,8+3,6+7,2+14,4=27	3+6+12+24=45
300	3+6+12+24=45	4,8+9,6+19,2+2x19,2=72

1) Connected to single-phase 220 V in low temp. version.

### Pressure drop

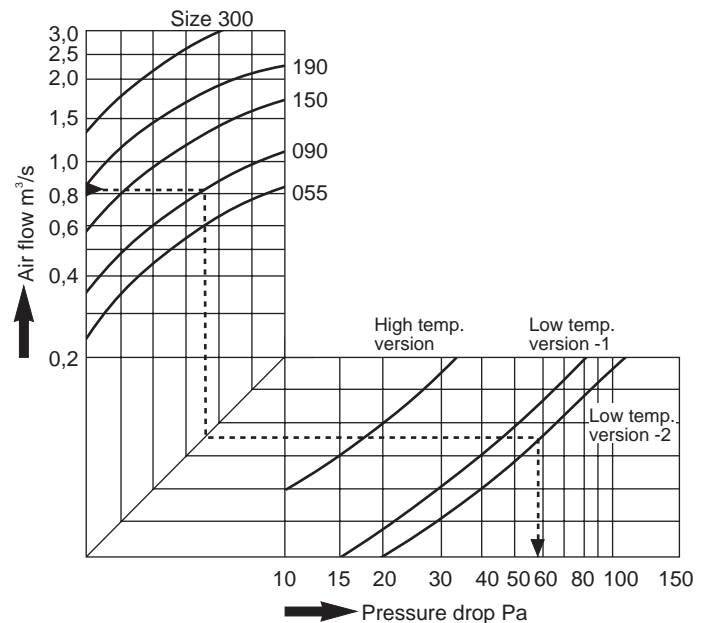


## Air heater unit FLBL

### General

The FLEV and FLEE air heaters can be installed and delivered in a separate unit, FLBL.


In this case, the supply air unit can be supplied without space provided for an air heater, and is then shortened to allow the entire unit to be passed through a 90 cm wide opening.

### Design

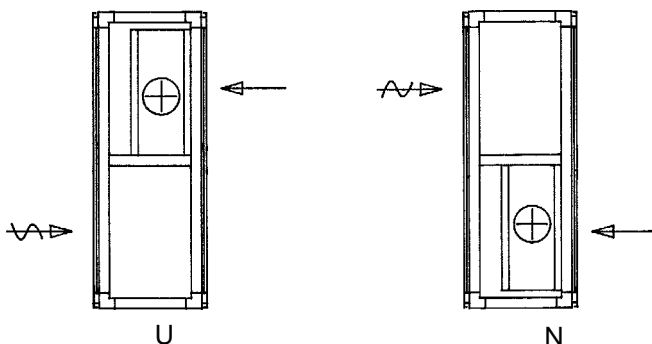

### Specification

AIR HEATER UNIT	FLBL -a -b -c -d
Size	[ 055, 090, 150, 190, 300 ]
Casing	[ 00 = Standard 30 = A 30 ]
Type	[ VA = Water heater EL = Electric heater ]
Version	[ U or N ]



# Air cooler FLBC

## Design

The FLBC air cooler is available as a water cooler or DX cooler. The coil body consists of aluminium fins with a pitch of 2 mm and copper pipes through which media the can flow.

In the water cooler version, the collecting pipes are made of steel and have recesses for draining and ventilation.

The DX coil has collecting and distributing pipes made of copper designed for solder joints.


Max. operating pressure, 15 above atm pr.


The air coolers are fitted with a corrosion-resistant drip tray with a drain connection.

At air velocities above 2,5 m/s, the droplet separator should be used to avoid the excitation of condensation water.


## Technical data

### DX-cooler

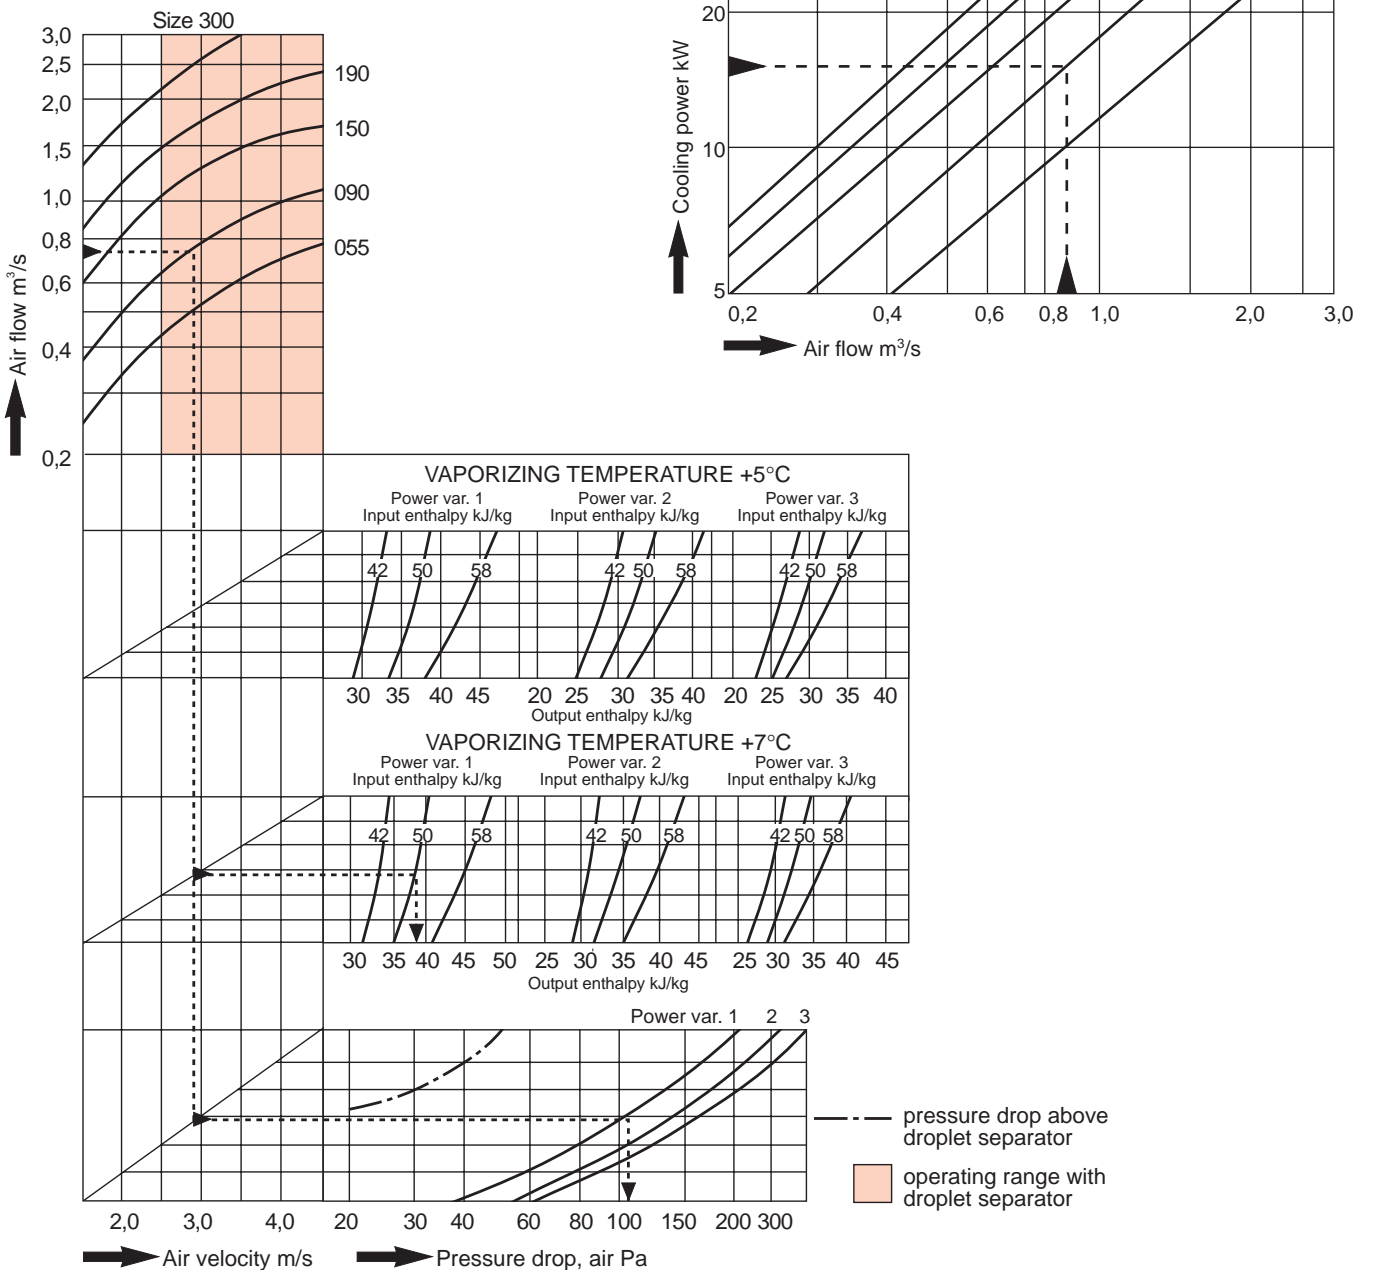



## Technical data Aircooler water

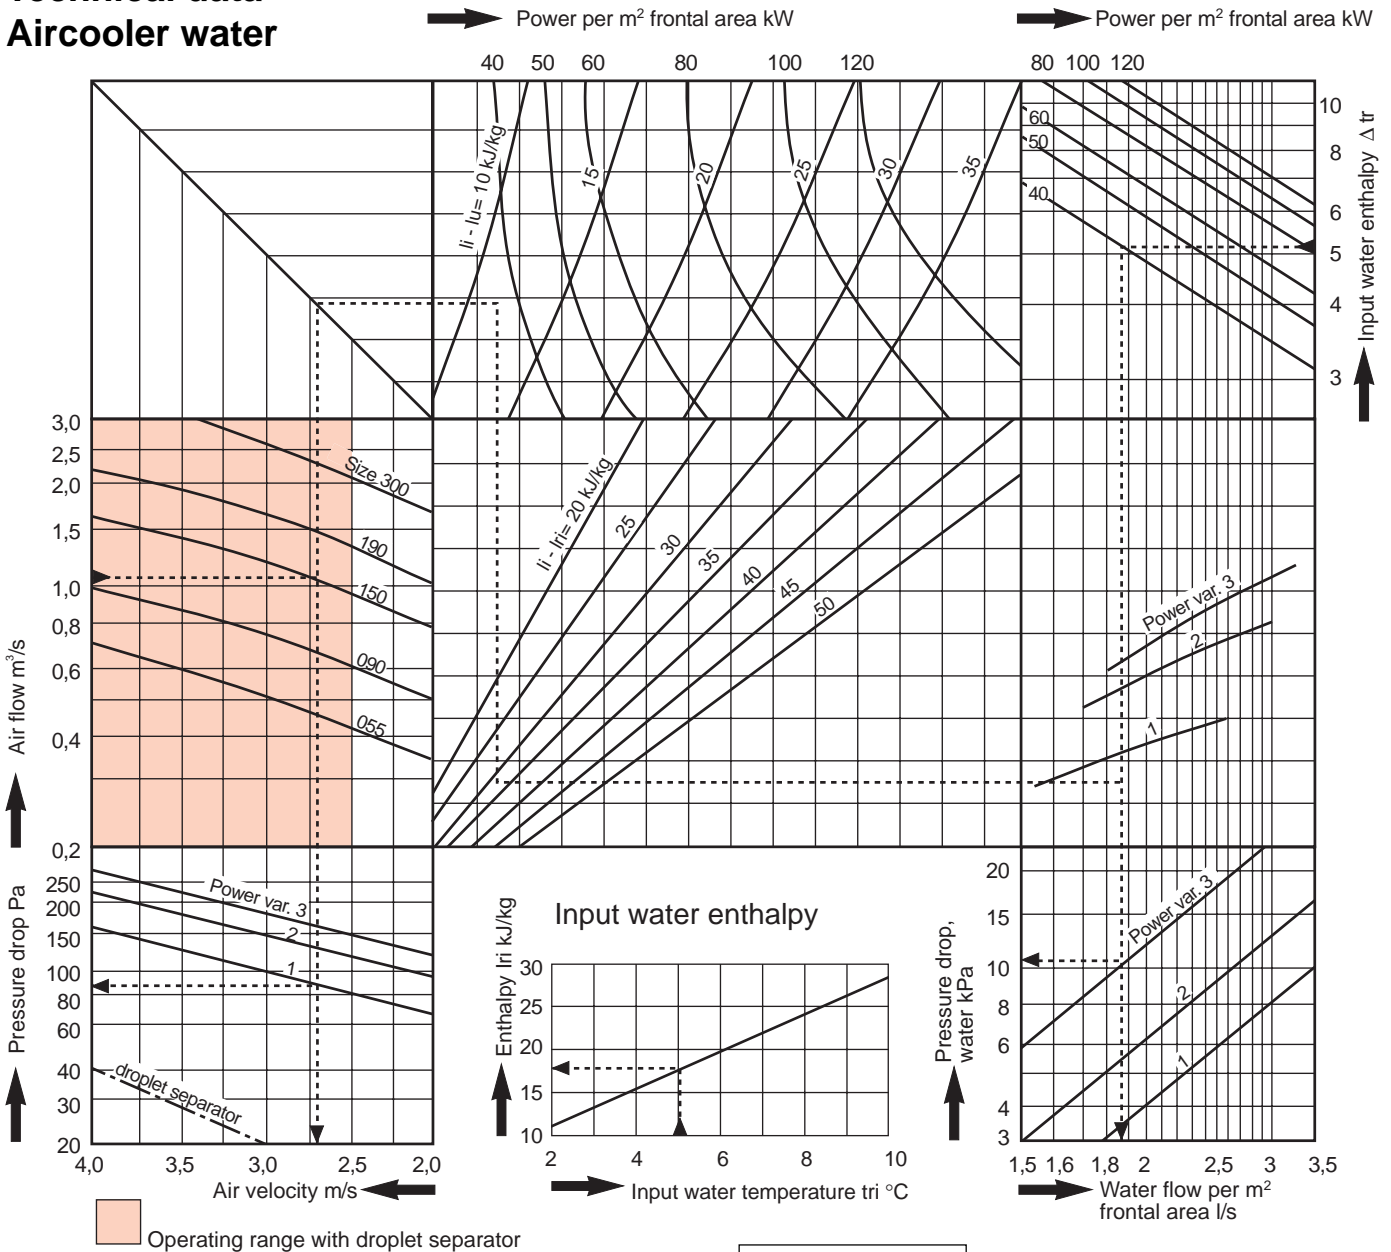

Operating range with droplet separator

### Example:

Given:

Air flow = 1.1 m<sup>3</sup>/s

Input air temperature  $t_i = +25^\circ\text{C}$

RH of input air = 50%

Output air temp.  $t_u = +15^\circ\text{C}$

Input water temp.  $t_{ri} = +5^\circ\text{C}$

Output water temp.  $t_{ru} = +10^\circ\text{C}$

Size 150  $A=0.40\text{ m}^2$

### Solution:

According to the Mollier chart:

Enthalpy of input air  $l_i = 50\text{ kJ/kg}$

Enthalpy of output air  $l_u = 38\text{ kJ/kg}$

According to the chart:

Enthalpy of input water  $l_{ri} = 18\text{ kJ/kg}$

Read off the chart with air flow 1.1 m<sup>3</sup>/s

Select size 150

Follow the dashed line. At  $l_u - l_i = 12\text{ kJ/kg}$ , the power will be 38 kW per m<sup>2</sup> frontal area.

Move to the "break-off" line  $l_i - l_{ri} = 32\text{ kJ/kg}$  and on to the chart to determine the power variant.

Frontalarea A m <sup>2</sup>	
Size	Area
055	0,17
090	0,25
150	0,40
190	0,55
300	0,85

Use water temperature difference  $t_r = 5^\circ\text{C}$  and move via power 38 kW per m<sup>2</sup> in the chart to determine the power variant.

Select the power variant (1) that is nearest above the break-point which arises.

The following can be obtained from the chart:

Air velocity = 2.7 m/s

(this means a droplet separator is required)

Pressure drop, air = 90 Pa

Power =  $A \times \text{power per m}^2 = 0,4 \times 38 = 15,2\text{ kW}$

Power variant = 1

Water flow =  $A \times \text{water flow per m}^2 = 0,40 \times 1,85 = 0,74\text{ l/s}$

Pressure drop, water = 10,5 kPa


## Air cooler unit FLBK

### General


The FLBK air cooler unit is a unit in which the FLBC air cooler is placed.

The shorter version is designed for an air cooler with power variant 1 or 2 without droplet separator. In other cases, the longer version must be used.

### Version

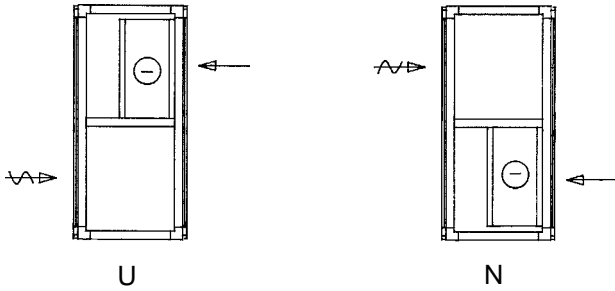

### Installation

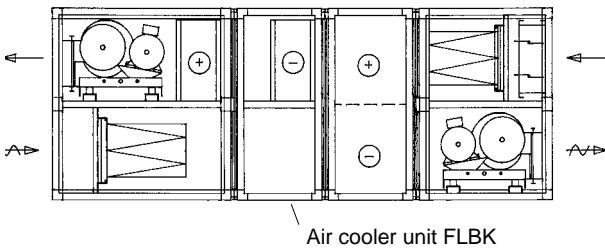

**Example 1:** With the DX cooler, the air cooler can be placed between the air heater and the heat recovery unit. If the supply air temperature is less than +14°C, however, the installation should be made as shown in example 2.


## Recirculated air unit FLBB

### General

The FLBB recirculated air unit is used in installations in which the retention of heat at nights is achieved by means of a recirculated air operation.


The unit includes two dampers with the tightness class 3 that are connected to a common output shaft.

### Version

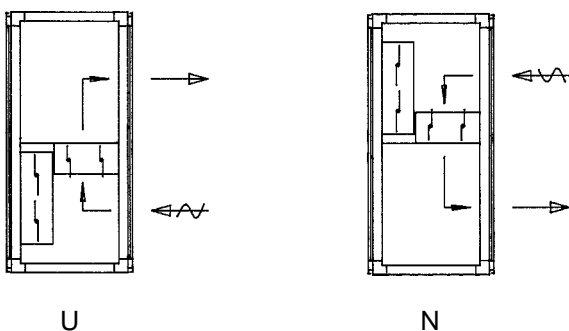

### Specification

AIR COOLER UNIT	FLBK	-a	-b	-c	-d	-e
Size	[ 055, 090, 150, 190, 300 ]					
Casings	[ 00 = Standard 30 = A 30 ]					
Variant	[ K = Short L = Long ]					
Version	[ U or N ]					
Connection side	[ H = right V = left ]					

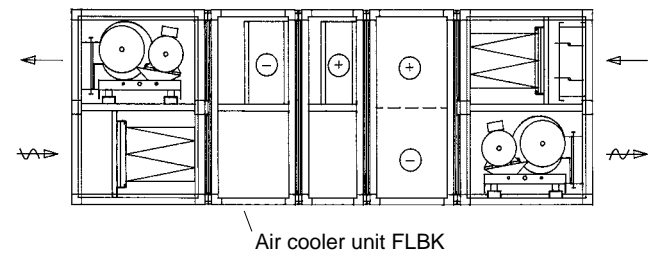



**Example 2:** To avoid freezing in the air cooler, it should always in the case of a water cooler be placed behind the air heater.

### Specification

RECIRCULATED AIR UNIT	FLBB	-a	-b	-c	-d
Size	[ 055, 090, 150, 190, 300 ]				
Casings	[ 00 = Standard 30 = A 30 ]				
Version	[ U or N ]				
Connection side	[ H = right V = left ]				

### Installation

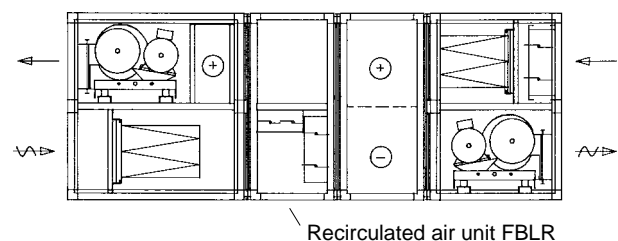



## Measuring unit FLBD

### General

The FLBD measuring unit can be used for simple forms of measuring the total flow or for continuous flow monitoring.

The measuring unit has a measuring outlet for both supply and exhaust air flows.

It can also be used as an inspection unit between the air heater and heat recovery unit, for example. When measuring efficiency, a temperature sensor can be placed in the measuring unit.


To achieve the best possible measuring results, the measuring unit should be installed as shown in the example below.

### Specification


#### MEASURING UNIT

		FLBD	-a	-b	-c
Size	055, 090, 150, 190, 300				
Casings	00 = Standard 30 = A 30				
Version	U or N				


### Pressure drop

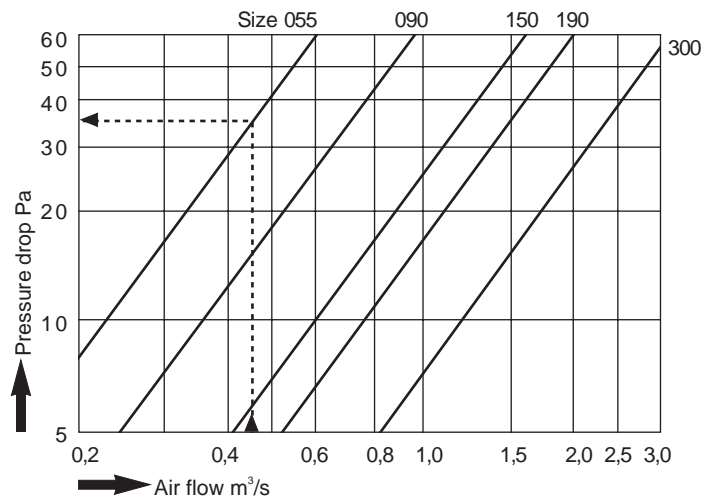


### Version

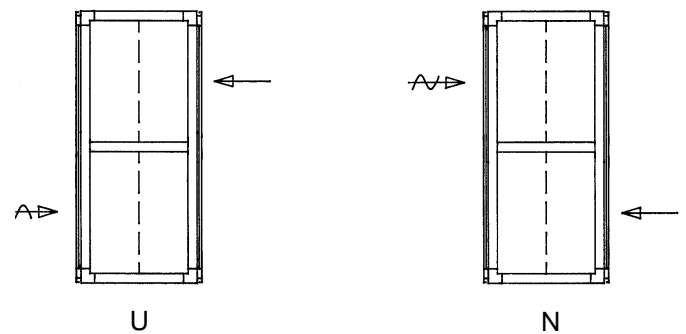

### Installation

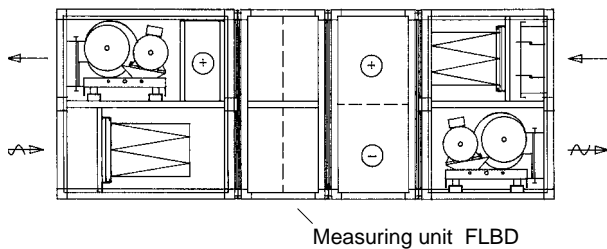

Example 1: Measuring unit placed between air heater and heat recovery unit.

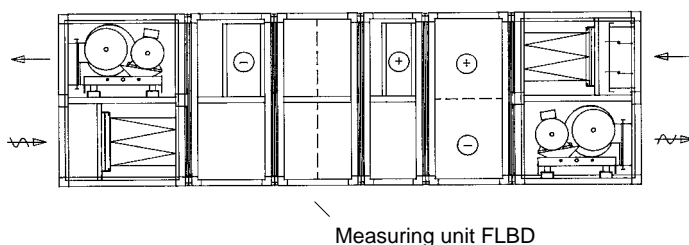

Example 2: Measuring unit placed between air heater and air cooler.



## Inspection unit FLBI

### General

The FLBI inspection unit can be used in installations where there are special requirements for inspection and cleaning. It can be placed between the heat recovery unit and air heater, for example.

## Media unit FLBM

### General

The FLBM media unit has space for an apparatus cabinet and shunt group. The space for the apparatus cabinet is entirely separate from the air flow. Pass-throughs have been prepared for input feed. In the unit installation, the media unit is placed between the air heater and heat recovery unit.

In the unit installation, the media unit is placed between the air heater and heat recovery unit.

For sizes 055-150, the shunt group is fitted on the outside. For other sizes it is fitted on the inside.

### Specification


INSPECTION UNIT		FLBI -a -b -c		
Size	[ 055, 090, 150, 190, 300 ]			
Casing	[ 00 = Standard 30 = A 30 ]			
Variant	[ K = Short L = Long ]			

### Specification

MEDIA UNIT		FLBM -a -b	
Size	[ 055, 090, 150, 190, 300 ]		
Casing	[ 00 = Standard 30 = A 30 ]		


## Installation


### Sizes 055-150

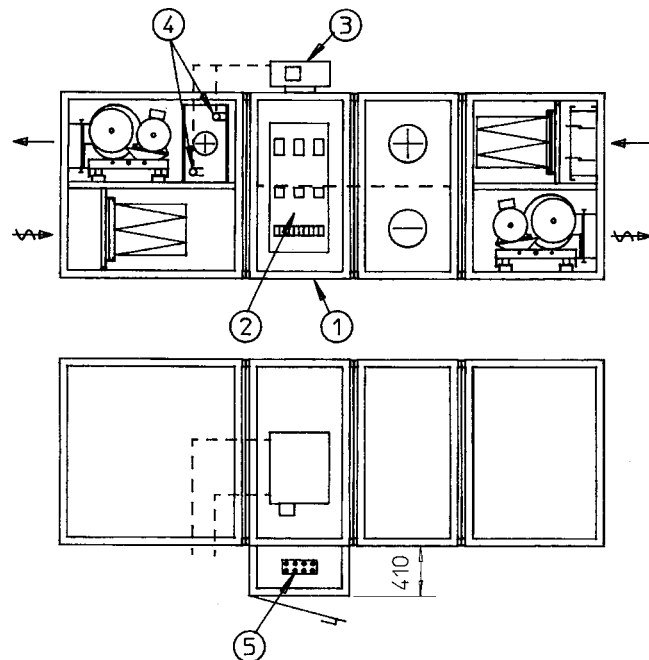

1. Media unit FLBM
2. Apparatus cabinet
3. Shunt group
4. Thermometer
5. Cable pass-through

### Sizes 190 - 300

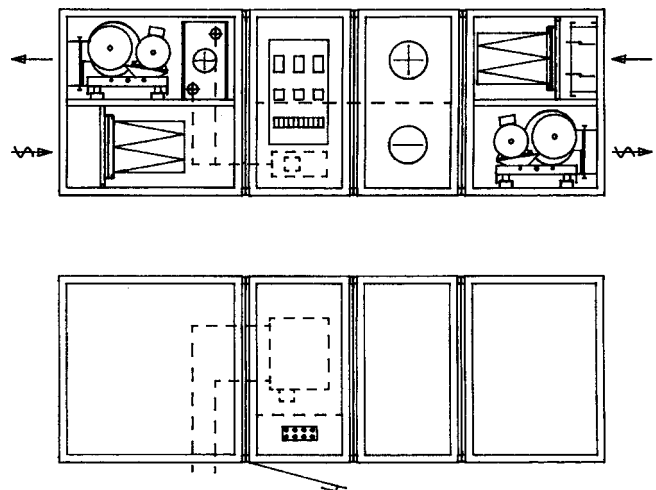




## Sound attenuator FLET-04


### Design

The sound attenuators consist of a hot galvanized sheet steel casing with 200 mm thick baffle elements made of mineral wool, and with a layer of fibreglass fabric on the air side. The distance between baffles is 100 mm. To reduce the pressure drop, the baffles are "pointed" at the inlet and outlet. The sound attenuator can be connected directly to the unit inlet. When installing on the fan outlet, a spacer should be placed between the unit and the sound attenuator.

### Installation

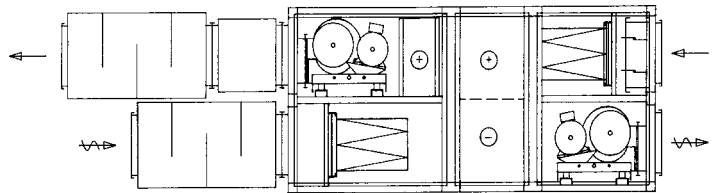


### Pressure drop

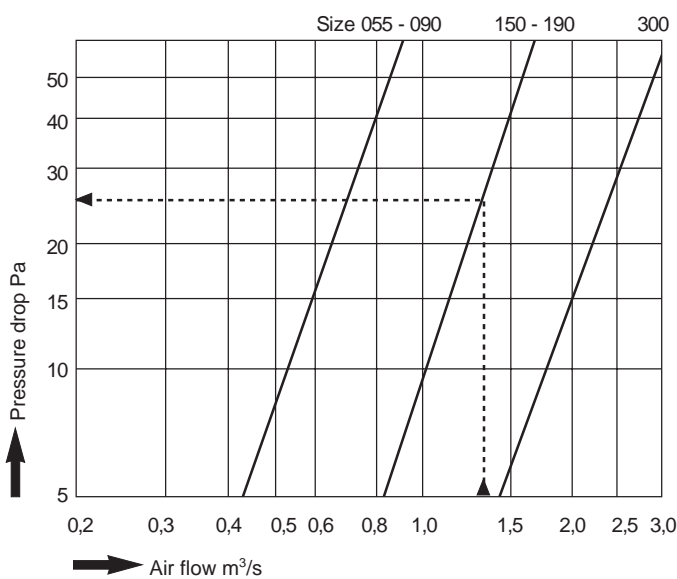

### Sound damping

Octave band	1	2	3	4	5	6	7	8
Middle frequency Hz	63	125	250	500	1000	2000	4000	8000
Damping dB	8	11	19	29	40	35	27	19


### Dimensions and weights

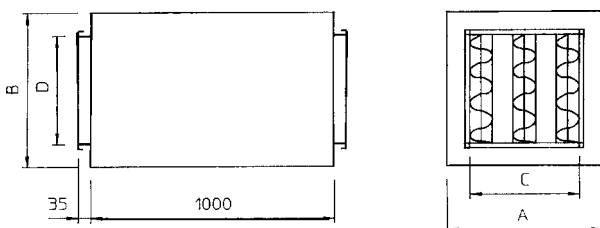

Size	A	B	C	D	Weight kg
055	600	400	300	300	36
090	600	400	400	300	37
150	900	500	600	400	57
190	900	500	800	400	57
300	1200	700	1000	500	95

## Spacer unit FLET-05

### Dimensions and weights

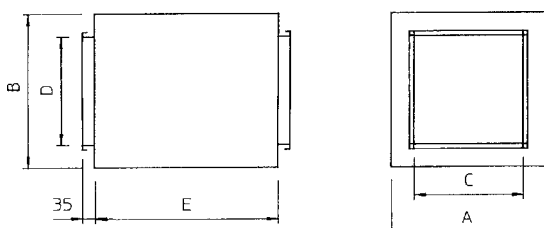


Size	A	B	C	D	E	Weight kg
055	350	350	300	300	230	4
090	450	350	400	300	230	5
150	650	450	600	400	330	8
190	850	450	800	400	330	11
300	1050	550	1000	500	430	14

## Connecting frame FLET-02

### General

FLET-02 connecting frames are prepared for a PG connection of ducts. As they are ordered together with the unit, they are fitted on both the supply and exhaust sides.



### Dimensions

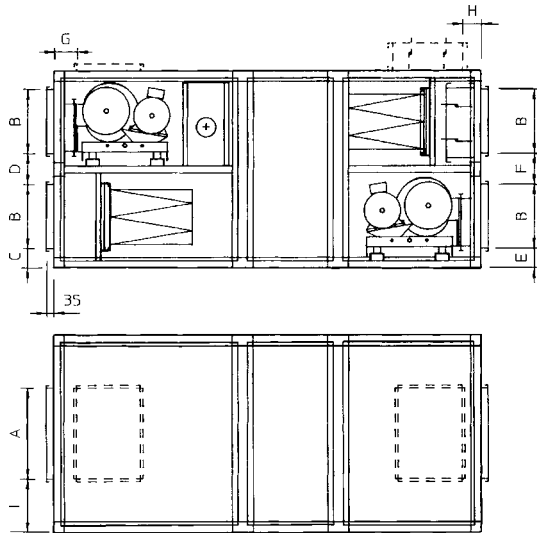

## Frame FLET-07, FLBT-07

### General

A frame can be supplied for installing the unit in a fan compartment. The frame is manufactured from steel sections and is provided with legs with adjustable feet. They are delivered in kit form.

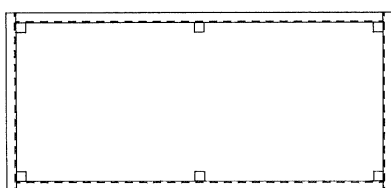

Vers.	Size	A	B	C	D	E	F	G	H	I
Standard	055	300	300	70	120	80	100	85	70	275
	090	400	300	100	155	80	200	85	100	290
	150	600	400	100	150	80	190	85	100	285
	190	800	400	140	190	80	310	85	140	265
	300	1000	500	150	200	80	345	85	150	290
A-30	055	300	300	105	120	115	100	120	105	300
	090	400	300	135	155	115	200	120	135	315
	150	600	400	135	150	115	190	120	135	310
	190	800	400	175	190	115	310	120	175	290
	300	1000	500	185	200	115	345	120	185	315

## Air flow meter FLET-10


### General

The FLET-10 is an air flow meter which, together with measuring unit FLDB, indicates the relevant air flow in the unit. The air flow is read off continuously from an indicator instrument on the flowmeter.

### Function

The air flow is indicated as a percentage (%). 0 (zero) % is the same as no flow, and 100% is the same as full flow for the relevant unit size. The percentage read off is translated into m<sup>3</sup>/s on a chart fitted on the unit.


An output signal 0-10 from the FLET-10 can be used for:

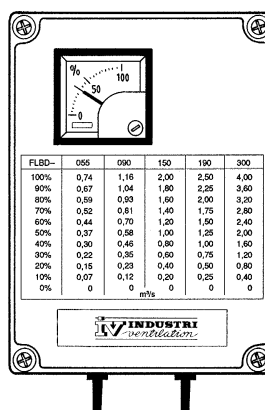

- Parent monitoring system
- Alarm function for high and low flow
- Flow control via control centre

### Tecnichal data FLET-10

Voltage supply	24 V AC
Power consumption	4 VA
Dim. W x H x D (mm)	125 x 175 x 85
Weight (kg)	0,3
Voltage output	0 - 10 V
Hose connection (x 2)	6 mm



## Description text FLEXOPAC

Flexopac air conditioning units of the IV- type

- FLE unit assembly in version
- FLB block unit in version

The unit should have a frame made up of extruded aluminium sections, and a casing made of

- hot galvanized sheet steel
  - aluminium coated sheet steel
- and also inspection doors/hatches fitted with hinges.

### The casing should be insulated

- with 25 mm mineral wool (standard) and coated on the inside with metal plate
- in a type approved A 30 version

### The unit is supplied for

- indoor installation
- outdoor installation

### Heat recovery

should be of the

- rotary type with a rotor made of
  - aluminium, non-treated
  - aluminium, hygroscopic

and with

- on/off control
- electronic speed control
- heatbank (heat pipe exchanger)
  - single version
  - double version
  - industrial version
- plate heat exchanger

fitted with a corrosion resistant drip tray with drain connection and by-pass and shut-off valves.

### The supply air fan should have

- forward curved blades
- backward curved blades
- backward curved blades and guide vanes
- and purging door

and also be retractible, belt-driven, and vibration insulated.

### The exhaust air fan should have

- forward curved blades
- backward curved blades
- backward curved blades and guide vanes
- and purging door

and also be retractible, belt-driven, and vibration insulated.

### The unit should also include

- a type 3 outdoor air damper
- a deep-folded supply air filter
  - EU 3
  - EU 6
  - EU 7

panel filter  aluminium mesh including U-tube manometer

- air heater for
  - water heater
  - electric heater  low temperature  high temperature

- air cooler for
  - water cooler
  - DX cooler
  - with droplet separator
- type 3 exhaust air valve
- deep-folded exhaust air filter
  - EU 3
  - EU 6
  - EU 7

panel filter  aluminium mesh including U-tube manometer

- air heater unit FLBL
- air cooler unit FLBR
- recirculated air unit FLBR
- inspection unit FLBI  short  long

- measuring unit FLBD
- media unit FLBM
- sound attenuator, supply air FLET-04
- sound attenuator, exhaust air FLET-04
- spacer unit, supply air FLET-05
- spacer unit, exhaust air FLET-05
- connecting frame for guide connection FLET-02
- frame with adjustable feet FLET-07

### The delivery package should also include

Replacement filters for

- |                                         |                                         |
|-----------------------------------------|-----------------------------------------|
| Supply air                              | Exhaust air                             |
| <input type="checkbox"/> EU 3           | <input type="checkbox"/> EU 3           |
| <input type="checkbox"/> EU 6           | <input type="checkbox"/> EU 6           |
| <input type="checkbox"/> EU 7           | <input type="checkbox"/> EU 7           |
| <input type="checkbox"/> Aluminium mesh | <input type="checkbox"/> Aluminium mesh |

Replacement belts for

- Fans
- Rotary heat recovery unit

### Dimensioning data

Supply air flow	...m <sup>3</sup> /s
Supply air, external pressure drop	...Pa
Exhaust air flow	...m <sup>3</sup> /s
Exhaust air, external pressure drop	...Pa
Outdoor air temperature (DUT)	...°C
Supply air temperature	...°C
Exhaust air temperature	...°C
Relative humidity, exhaust air	...%RH
Temperature efficiency, heat exchanger, dry	...%
Heating water	.../...°C
Coolant	.../...°C
Refrigerant, DX cooler	.../...°C
Vaporizing temperature, DX cooler	.....
Cooling power	...kW
Input air temperature	..°C
Input relative humidity	...%RH